



# Test rooms to study human comfort in buildings: A review of controlled experiments and facilities

A.L. Pisello<sup>a,b,\*</sup>, I. Pigliautile<sup>a,b</sup>, M. Andargie<sup>c</sup>, C. Berger<sup>d</sup>, P.M. Bluyssen<sup>e</sup>, S. Carlucci<sup>f,g</sup>, G. Chinazzo<sup>h</sup>, Z. Deme Belafi<sup>i</sup>, B. Dong<sup>j</sup>, M. Favero<sup>g</sup>, A. Ghahramani<sup>k</sup>, G. Havenith<sup>l</sup>, A. Heydarian<sup>m</sup>, D. Kastner<sup>n</sup>, M. Kong<sup>j</sup>, D. Licina<sup>o</sup>, Y. Liu<sup>j</sup>, A. Luna-Navarro<sup>p</sup>, A. Mahdavi<sup>d</sup>, A. Nocente<sup>q</sup>, M. Schweiker<sup>r</sup>, M. Touchie<sup>c</sup>, M. Vellei<sup>s</sup>, F. Vittori<sup>b</sup>, A. Wagner<sup>t</sup>, A. Wang<sup>m</sup>, S. Wei<sup>u</sup>

<sup>a</sup> Department of Engineering, University of Perugia, Perugia, Italy

<sup>b</sup> CIRIAF – Interuniversity Research Center, University of Perugia, Perugia, Italy

<sup>c</sup> Department of Civil and Mineral Engineering, University of Toronto, Toronto, ON, Canada

<sup>d</sup> Department of Building Physics and Building Ecology, TU Wien, Vienna, Austria

<sup>e</sup> Faculty of Architecture and the Built Environment, Delft University of Technology, Delft, the Netherlands

<sup>f</sup> Energy, Environment and Water Research Center, The Cyprus Institute, Nicosia, Cyprus

<sup>g</sup> Department of Civil and Environmental Engineering, Norwegian University of Science and Technology, Trondheim, Norway

<sup>h</sup> Department of Civil and Environmental Engineering, Northwestern University, Evanston, USA

<sup>i</sup> Department of Building Services and Process Engineering, Faculty of Mechanical Engineering, Budapest University of Technology and Economics, Hungary

<sup>j</sup> Department of Mechanical and Aerospace Engineering, Syracuse University, Syracuse, NY, USA

<sup>k</sup> Department of Building, National University of Singapore and Center for the Built Environment, UC Berkeley, USA

<sup>l</sup> Environmental Ergonomics Research Centre, Loughborough University, School of Design and Creative Arts, Loughborough, UK

<sup>m</sup> Department of Engineering Systems and Environment, Link Lab, University of Virginia, USA

<sup>n</sup> Institute of Energy Efficiency and Sustainable Building E3D, RWTH Aachen University, Aachen, Germany

<sup>o</sup> Human-Oriented Built Environment Lab, School of Architecture, Civil and Environmental Engineering, École Polytechnique Fédérale de Lausanne, Lausanne, Switzerland

<sup>p</sup> Department of Engineering, University of Cambridge, Cambridge, UK

<sup>q</sup> SINTEF AS, Trondheim, Norway

<sup>r</sup> Institute for Occupational, Social and Environmental Medicine, Medical Faculty, RWTH Aachen University, Aachen, Germany

<sup>s</sup> LaSIE (UMR CNRS 7356), La Rochelle University, La Rochelle, France

<sup>t</sup> Building Science Group, Karlsruhe Institute of Technology, Karlsruhe, Germany

<sup>u</sup> The Bartlett School of Construction and Project Management, University College London, London, UK

## ARTICLE INFO

### Keywords:

Test room  
Laboratory  
Climate chamber  
Human comfort  
Human-centric experiments  
Thermal comfort  
Visual comfort  
Acoustic comfort  
Indoor air quality  
Multi-domain comfort  
Energy performance  
Indoor environmental quality

## ABSTRACT

Occupants' comfort perception affects building energy consumptions. To improve the understanding of human comfort, which is crucial to reduce energy demand, laboratory experiments with humans in controlled environments (test rooms) are fundamental, but their potential also depends on the characteristic of each research facility. Nowadays, there is no common understanding for definitions, concepts, and procedures related to human comfort studies performed in test rooms. Identifying common features would allow standardising test procedures, reproducing the same experiments in different contexts, and sharing knowledge and test possibilities. This review identifies 187 existing test rooms worldwide: 396 papers were systematically selected, thoroughly reviewed, and analysed in terms of performed experiments and related test room details. The review highlights a rising interest in the topic during the last years, since 46% of related papers has been published between 2016 and 2020. A growing interest in non-thermal sensory domains (such as visual and air quality) and multi-domain studies about occupant's whole comfort emerged from the results. These research trends have entailed a change in the way test rooms are designed, equipped and controlled, progressively becoming more realistic inhabitable environments. Nevertheless, some lacks in comfort investigation are highlighted: some continents (like Africa and South America) and climate zones are found to be underrepresented, while involved subjects are mainly

\* Corresponding author. Department of Engineering, University of Perugia, Perugia, 06125, Italy.

E-mail address: [anna.pisello@unipg.it](mailto:anna.pisello@unipg.it) (A.L. Pisello).

<https://doi.org/10.1016/j.rser.2021.111359>

Received 21 December 2020; Received in revised form 27 May 2021; Accepted 10 June 2021

Available online 30 June 2021

1364-0321/© 2021 Elsevier Ltd. All rights reserved.

students performing office tasks. This review aspires to guide scientists and professionals toward the improved design or the audit of test room experimental facilities, especially in countries and climate zones where human comfort indoors is under-studied.

### List of abbreviations

IEQ	Indoor Environmental Quality
WWR	Window-to-wall ratio (expressed in %)
HVAC	Heating, Ventilating and Air Conditioning
ACH	Air Change per Hour
VOCs	Volatile Organic Compounds
SPL	Sound Pressure Level (expressed in dB)
SBS	Sick Building Syndrome
EEG	Electroencephalogram
EDA	Electrodermal activity
ECG	Electrocardiogram
EOG	Electrooculography

## 1. Introduction

People in developed countries spend 85–90% of their time indoors [1]. Notwithstanding undeniable improvements in the quality of building interiors in the past decades, a range of health risks and discomfort issues associated with exposure to the indoor environment persists. Researchers have demonstrated the strong connection between the indoor environmental quality (IEQ) of a building and occupants' comfort, health, and productivity [2,3]. Moreover, buildings' energy consumption is largely affected by occupants' behaviour [4], triggered by their perception of the surrounding environment [5]. Therefore, decoding human comfort is a crucial issue in building science for enhancing building design and operation from a sustainable perspective and through a human-centric approach [6].

The scientific community approaches human indoor comfort by coupling measurements of the physical environment (e.g., air temperature, sound pressure level, air pollutant concentrations, illuminance) and occupants' feedback collected via surveys, behavioural and/or physiological monitoring. Applied experimental protocols can be broadly categorized into (i) in-field monitoring and (ii) laboratory experiments.

In-field experiments allow researchers to observe subjects in a real environment such as workplaces [7,8], residential [9] or educational [10] buildings, or even semi-open transitional urban spaces [11]. This approach provides essential outcomes, especially for assessing the impact of real-space configurations on occupants' perception [12], the effects of building characteristics on occupants' wellbeing [13], or the impact of occupants' behaviour on buildings' energy consumption [14, 15]. However, it does not allow to directly control the environmental parameters of the investigated spaces. Indeed, it is not feasible to isolate the contribution of a single environmental factor or a specific combination of multiple environmental stimuli on subjective responses, for example, overall comfort perception or productivity [16] in in-field research, while this is fundamental to establish a cause-effect relationship related to the comprehension of human comfort and the related occupancy behaviour [17]. These issues can be solved through experiments in controlled environments where desired physical boundaries can be determined and replicated, so different subjects can be exposed to the same stimuli and the influence of subjective factors elucidated [18]. Moreover, laboratory experiments generally allow researchers to perform a more detailed investigation of human subjects and collect physiological signals less commonly monitored in-field.

Many research institutions have built their own environmentally controlled experimental facilities to perform human comfort-related experiments worldwide and throughout the years. Each facility is designed to achieve specific research goals, thus presenting different dimensions, internal layouts, envelope characteristics, energy systems, and monitoring setup. Different equipment types are also included depending on the final aim of an experimental campaign targeting a specific comfort domain. Examples include thermal manikins, commonly simulating human thermal comfort [19] or inhalation exposure [20], or different apparatus for studying the human reaction to specific environmental input such as glare discomfort [21,22]. The test room design influences the experimental design and the accuracy of related modelling. The construction and technological details of the test room decide on the extent and scope of the different stimuli that can be provided as well as the different spatial layouts that can be generated. Being an essential determinant of experimental methodology, a careful design process of these facilities is of primary importance.

Due to the rising interest in better understanding human comfort, many reviews shed light on different perspectives of the topic. Several reviews summarise visual-related studies, reporting both lab and field investigations, as well as simulation studies [24–27]. Others focus on thermal comfort and different modelling approaches [28], main experimental procedures [29,30], or its energy-related implications [31]. Nevertheless, none addresses the diversity of laboratory facilities, which is a key component in the design of human-centred comfort experiments.

The identification of standard tools for advancing knowledge in the field would be helpful for the scientific community. An accepted glossary for identifying such facilities is still missing. Many papers refer to these facilities as test rooms or chambers or test-cells or simply laboratories. Here, “test room” was chosen as the most representative definition, highlighting the differences between facilities designed for human comfort studies and laboratory equipment devoted to material testing. Moreover, we define a “test room” as an enclosed space, environmentally controlled and properly instrumented, in which human-centric comfort studies can be performed through actual occupants' presence and monitoring.

This review aims at describing existing test rooms worldwide and at summarizing experimental studies on human comfort performed in such facilities to outline trends in the field, common components, and define new research perspectives. Precise selection criteria of the papers have been identified and used for the critical review (Section 2), and common technical features and trends in construction have been taken into account (Section 3), while Section 4 focuses on the specific experiments conducted in these facilities to deepen human comfort theory. Each experiment was categorized based on the type of domain(s) of human perception involved (thermal, visual, olfactory, and aural). In this context, a distinction was made between single-domain studies, which describe experiments focusing on thermal, visual, indoor air quality or acoustical stimuli only, and multi-domain studies [18,32], which simultaneously address two or more domains; for instance, the analysis of thermal and acoustic stimuli on overall comfort perception, or the analysis of thermal perception as influenced by lighting or air quality conditions. The key findings and conclusions, including suggestions for future research agenda, are summarised and critically discussed in Sections 5 and 6, respectively.

## 2. Materials and methods

A systematic bibliographic search was planned and conducted to establish a database as comprehensive as possible, looking at existing

test rooms for human comfort experiments according to available scientific literature and not to miss any test rooms that the authors are aware of. The final database is thus the result of two main steps: an automatic search and a supplementary hand search (Fig. 1).

The automatic search was systematically conducted through Scopus and Web of Science scientific databases to identify papers concerning human comfort investigation in test rooms, as available up to June 2020. The search was limited to journal papers written in English after 1985 to keep the search consistent between the two scientific databases due to the temporal limitation of Web of Science. To cover the scientific literature on the theme published before 1985, a further search was conducted in Google Scholar. Different typologies of documents such as books, book chapters, reviews, or conference proceedings were thus excluded from the search to improve consistency and avoid repetitions of the same study that may have been presented in different document types. Five queries were designed within these boundaries, corresponding to each aspect of indoor human comfort. The queries were structured in three parts, progressively focusing on the purpose of the review:

- (i) on the laboratory facility where human comfort experiments took place,
- (ii) on the main aim of the studies, i.e., human comfort, and
- (iii) on the specific comfort domain of interest (e.g., thermal, visual, acoustic, air-quality related).

Each part of the query was detailed after a discussion among the authors that are experts in human comfort studies and come from different countries and cultural backgrounds. These cultural differences provide a comprehensive definition of the facilities object of the review. The first two parts of the query were used for all the five queries and consisted of the following keywords: (testroom OR test-room OR chamber OR laborator\* OR "test cell") AND comfort. The term "human" was not included for not missing any contributions that may fit the scope but did not explicitly mention humans' involvement. The publications not dealing with human comfort were excluded through the double-screening procedure, as specified in the following. In addition to these keywords, the five queries were distinguished by including the following specific keywords:

1. Thermal
2. Visual OR Lighting
3. Acoustic
4. Air quality OR Pollution
5. Energy

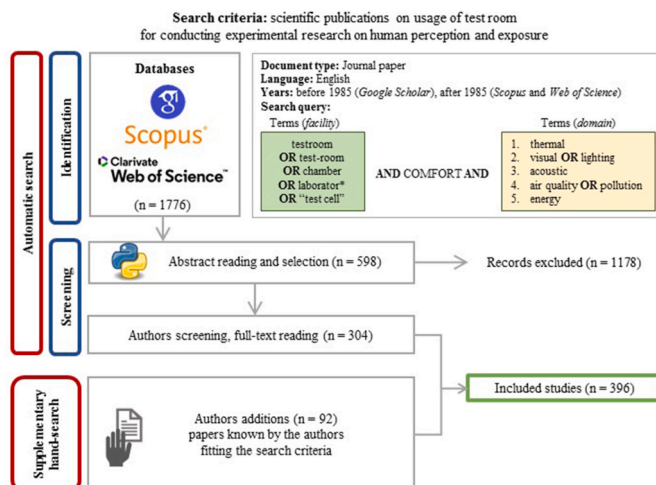


Fig. 1. Papers selection workflow.

Each specific query focused on a single comfort aspect addressed from the perspective of the provided physical stimulus, as associated with thermal, visual, aural and olfactory human perception. In contrast, the fifth query focused on the theme of energy that is commonly associated with human comfort studies aimed at improving indoor environmental quality while reducing building energy consumption.

The automatic bibliographic search resulted in 1776 papers. A cleaning procedure of the database was performed by focusing only on experiments both carried out in a controlled environment and addressing human perception and exposure. This procedure accounts for two main steps. The first screening was conducted through a specifically developed script in Python language for automatic abstract screening by excluding papers presenting specific words referred to out-of-scope disciplines such as medicine or veterinary medicine. After this first screening, 598 papers were still included in the review process, and went through the second screening phase: the papers were carefully read and selected according to the primary purpose of the review. Only papers describing experiments performed in the controlled environments (test rooms) whose internal dimensions and conditions were suitable for human experiments were considered for this review.

The hand search was carried out for reducing the automatic search biases and limiting the number of existing test rooms not covered by this review. Additional papers were included according to the previous knowledge of the authors and the selection criteria that is the usage of a controlled environment for conducting experimental research on human perception and exposure. More than half of the additional papers (49 out of the 92) concern the visual comfort domain, meaning that common keywords coming from the other domains were not suitable to catch all the visual comfort studies. The final number of analysed papers was 396.

Table 1 summarises the number of analysed papers per topic and year of publication, considering four time periods: (i) up to 2000, (ii) 2001–2010, (iii) 2011–2015, and (iv) 2016–2020. Defined time periods highlight the considerable increase in published papers on controlled test room experiments on human comfort. Indeed, the increase ratio observed during the first decade of the 21st century (1.9) is comparable to the one observed for the first (1.5) and second (1.7) part of the following decade.

The table depicts a predominant interest of the scientific community in thermal comfort investigations (conducted either in isolation or in combination with other factors) followed by energy-related studies (total of 85 papers) and visual comfort assessments. Air quality studies are less common, especially as a single stimulus for the participants involved in test room experiments. Indeed, the total amount of reviewed papers related to air quality assessment is 84. Only 18 of them were found to focus on air quality only as a single stimulus, disabling the olfactory from the thermal perception and all the other spheres of comfort. More detailed presentation of the aims and procedures of the air-quality-only studies is provided in Subsection 4.4.

Fig. 2 shows trends of publication for each specific domain of comfort, without distinguishing between single and multi-domains experiments, with respect to studies published before 2000. Thermal comfort-related experiments present the slowest increasing ratio from the reference scenario. Air quality-related experiments show the greatest increase in the number of published papers, with a slight decrease in the last five years. A similar trend can be observed for energy-related studies. Visual comfort-related studies are gaining more attention with currently seven times more papers compared to available publications before 2000. Aural comfort is the least investigated domain in controlled environments. Reviewed papers including a focus on acoustic comfort are 32 in total, half of which published in the last five years.


### 3. The test rooms around the world

From the 396 papers selected according to the systematic review process, 187 different test rooms located in 126 research institutes around the world have been identified based on the descriptions

**Table 1**

Number of journals papers published throughout years (up to June 2020) and concerning each analysed topic.

Domain(s)		Time periods				
		≤2000	2001–10	2011–15	2016–20 <sup>b</sup>	Total
1 domain	Thermal	26	39	50	89	204
	Air quality	3	3	4	8	18
	Acoustic	0	2	2	7	11
	Visual	5	10	23	32	70
2 domains	Thermal + Air quality	0	10	22	19	51
	Thermal + Acoustic	0	3	0	3	6
	Thermal + Visual	1	0	1	17	19
	Air quality + Acoustic	0	1	0	1	2
	Air quality + Visual	0	0	0	0	0
	Acoustic + Visual	0	0	1	1	2
3 domains	Thermal + Air quality + Acoustic	1	0	1	1	3
	Thermal + Air quality + Visual	0	1	1	0	2
	Thermal + Acoustic + Visual	1	0	0	1	2
	Air quality + Acoustic + Visual	0	0	0	0	0
4 domains	Thermal + Air quality + Acoustic + Visual	0	0	1	5	6
Total		37	69	106	181	396
energy related <sup>a</sup>		5	15	29	36	85
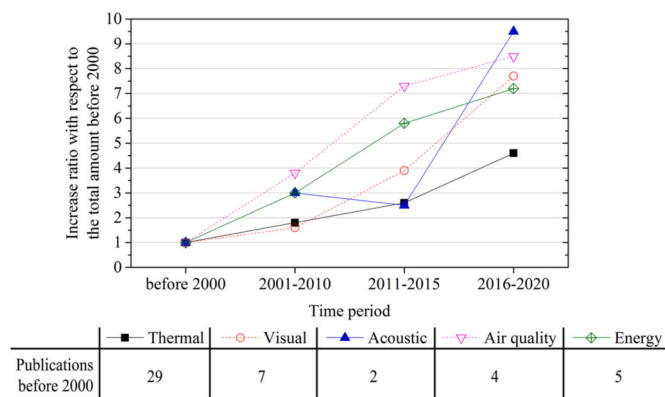
<sup>a</sup> The energy-related topic is transversal to the others.<sup>b</sup> The count for 2020 considers only those documents indexed until June 2020.**Fig. 2.** Publication increase ratio with respect to the number of published papers before 2000 for each query.

provided in the papers.

Fig. 3 summarises the test rooms distribution across continents (a,b) and different climate conditions (c), referring to the Köppen-Geiger climate classification [33]. Nowadays, the great majority of test rooms are located in Europe and Asia (82%), and in a temperate climate, without dry seasons, characterized by hot (Cfa) and warm (Cfb) summer. 29 out of the 44 test rooms located in the Cfa climate zone are in Asia (South and coastal area of Japan and South-Eastern China mainly), while 54 out of the 57 test rooms located in Cfb zones are in Europe (North-Western countries mostly). Fig. 3b presents how the worldwide distribution of these facilities varied across time (all the test rooms were dated per the oldest related paper available in the review dataset). European countries have the oldest tradition in human-related experiments conducted in controlled test room settings: 50% of the facilities already existing before 2000 were located in Europe. The number of facilities in Asia has grown over the last 20 years from 18 to 41% of the total number worldwide in 2020, overcoming the number of facilities located in North America (13%).

The following subsections are intended to provide helpful information for researchers evaluating whether to create or buy a test room for human comfort studies. These illustrate the range of test room characteristics that enable the researcher to perform different experiments and investigate specific aspects of human comfort. An overview of construction and technical details is provided in section 3.1 and 3.2, in accordance with the available information from the reviewed papers.


Then, sections 3.3 and 3.4 provide insights into the economic investment required to set up these kinds of facilities, either if these are customized or commercially available. Since none of the reviewed papers provides information on test room costs and related economic investment, data provided in sections 3.3 and 3.4 come from an additional search: an online survey was submitted to authors of the identified significant and recent literature, seeking details on key aspects of the needed economic investment (including design, construction, operation and maintenance costs). Finally, commercial test room producers (eight institutions from the U.S. and five institutions from Europe) were directly contacted to provide dedicated insights for the readers, reported in section 3.4.

### 3.1. Construction details

The construction details were specifically examined to determine how passive elements of the test room, including windows, shades, layout, size, and position within or external to an existing building, may allow or hinder different types of investigations. Unfortunately, comprehensive descriptions of the test rooms construction details are not always available. It was not possible to assess whether the test rooms are located inside a building or are entirely independent buildings for 10% of the 187 test rooms identified. According to the available information, only 7% of the facilities are independent buildings, external to any other building [34–47]. Five of these independent test rooms are located on a platform that allows the whole structure to rotate [34–37, 41]. The great majority are situated inside the related research institute. Among these, it is possible to distinguish between facilities completely detached from the surrounding structure (43%) and test rooms that are specifically equipped rooms within the hosting building (32%).

Some test rooms include more than one room. These rooms could be adjacent, but with independent entrances, or connected through an intermediate door. The latter configuration allows researchers to continuously monitor participants' reactions when exposed to different controlled environmental conditions [48]. Eight of the external facilities have just one room, but the possibility to work with movable internal partitions is mentioned for four of them [38,41,43,44]. The other six outdoor test rooms present two rooms, and four out of the six have movable partitions for changing the interior space layout [34,35,40,45]. For the inside test rooms, single room configurations are most common (79%), some of which can be modified through movable interior partitions (19%). More information about the number of rooms embedded in the test rooms and their dimensions are summarised in Table 2.



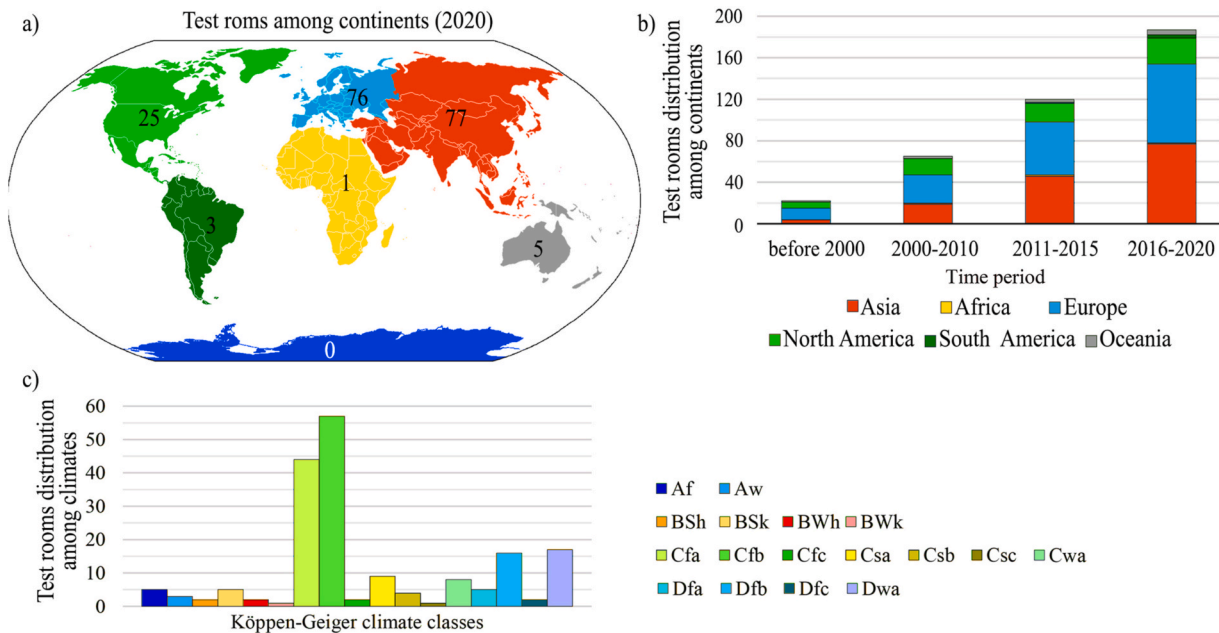

**Fig. 3.** (a) Number of test room facilities located in the seven continents; (b) amount of test rooms located in each continent for each defined time period; (c) frequency distribution of test rooms with respect to Köppen-Geiger climate classes [33].

**Table 2**

Test rooms composition and dimensions with respect to their position (inside or outside another building).

Test rooms position		Number of rooms				Dimensions [m <sup>3</sup> ]				Total
		1	2	>2	N/A	<9	9–20	>20	N/A	
Inside	Detached <sup>a</sup>	53	8	1	4	5	16	36	9	66
	Integrated <sup>a</sup>	37	8	2	2	0	4	43	2	49
	N/A	32	2	0	6	1	5	20	14	40
Outside		8	6	0	0	0	4	10	0	14
N/A		7	1	0	10	0	1	4	13	18
<b>Total</b>		<b>137</b>	<b>25</b>	<b>3</b>	<b>22</b>	<b>6</b>	<b>30</b>	<b>113</b>	<b>38</b>	<b>187</b>

<sup>a</sup> With respect to the building structure of the related research centre.


It was not possible to define whether the described test rooms present any type of openings for 41% of the recognized facilities, 25% of the test rooms located inside have no openings, 18% have windows facing the outside, 16% have windows to interior spaces, and just 2% have both windows to the outdoors and the indoors (Fig. 4). Among the 14 experimental facilities built outside, only one does not have windows [46]. At the same time, five include an adjustable envelope to vary the window-to-wall ratio (WWR) [35,37,41,43,45], five have a WWR lower than 0.5 [38,39,42,44,47], and three have a WWR in between 0.6 and 0.8 [34,36,40]. Concerning the shading system, it is clearly stated that there are external blinds in three test rooms [34,36,47], four present internal shading systems [38,40,42,44], while just one has both [39].

Half of the test rooms have no specific internal layout, meaning that there is no intention to simulate a real space but only to expose subjects to controlled environmental stimuli. Equipment for performing physical exercises are included in 10% of these test rooms [49–64]. All the others

have no specific furniture, even if 49% are larger than 20 m<sup>3</sup>. Finally, 12% of the analysed test rooms are presented in different papers with different internal layouts, 32% are equipped as offices, 3% as classrooms [65–69], and less than 1% present other configurations [70–73].

The above presented physical characteristics of the reviewed test rooms can be associated with their capability of performing different types of experiments, focusing on different domains of human comfort. The external test rooms are more commonly devoted to visual-related experiments. Indeed, six out of the 14 exterior test rooms are associated with visual-only experiments, while only one was used for testing human comfort conditions due only to thermal boundaries. When more than one domain is explored, four test rooms hosted experiments providing combinations of thermal and visual stimuli; the air quality influence was additionally explored in one test room while all the four domains of comfort were explored in only two of the 14 external test rooms.

With respect to performed experiments, it is more complicated to deduce the most common combination of construction details for the test rooms located inside other facilities due to a lack of information on all the analysed features. Only 82 out of 155 reviewed test rooms are described in terms of both (i) their position in the hosting facility (detached or integrated) and (ii) windows availability facing the inside or the outside. Accounting for these two aspects, detached test rooms generally have no window (56%) and are more commonly adopted for investigating human comfort under thermal stimuli only (46%). Those test rooms that are integrated into the main structure, as specially

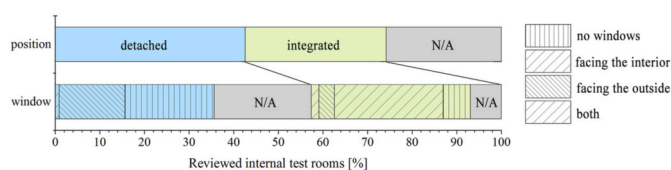

**Fig. 4.** Overview of the most common combination of characteristics for inside test rooms, in terms of its position with respect to the main structure and the windows availability.

equipped rooms, commonly have windows facing the outside (68%) and are mainly used for experiments on visual domain only (54%).

### 3.2. Technical details

Similar to the presentation of construction details, the technical capabilities of the test rooms directly inform what types of experiments can be conducted. Specifically, this subsection outlines which parameters are controllable and to what degree. As a first step, an analysis of the most common parameters that could be controlled by the test room systems was conducted. For this purpose, the relevant information was extracted from the corresponding papers for each test room and categorized as presented in Table 3.


This categorization is more granular than the multi-physics domains introduced in Section 2 (thermal, visual, air quality and acoustic comfort) to better characterize the specific system types used to influence each domain parameter. Indeed, in some cases, multiple controlled parameters will impact a single domain such as air temperature, mean radiant temperature and incoming solar radiation, all impacting thermal comfort. Additionally, the controlled parameters were subdivided into centralized and personalized systems (generally located at a desktop or at a participant/manikin). In the process of this categorization, 91 test rooms were selected for further analysis because related publications provided relevant and sufficient information. Fig. 5 summarises the number of test rooms which can control each of the listed parameters. In some cases, one test room is counted multiple times in this plot, once for each parameter its system controls.

The most common centrally controlled parameter is air temperature, followed by humidity and air quality control. All these three parameters can potentially be controlled by HVAC (Heating, Ventilation and Air Conditioning) systems with a humidifier and/or dehumidifier equipment, heating and/or cooling coils, and air filtering. The common practice of controlling thermal conditions in actual buildings, together with the predominant focus on thermal comfort studies (highlighted in Section 2), is likely why these controlled parameters are found to be so common. Fig. 6 summarises the ranges for each of these three controlled parameters for all of the test rooms where ranges were reported. As shown, nearly all the test rooms can control air temperature between 15 and 30 °C, and relative humidity between 30 and 70%, but air-speed control was more variable. Almost all test rooms were able to control these parameters at least in the ranges covered by indoor comfort standards such as ISO 7730 [74] and, in many cases, well beyond this range, particularly with respect to the seven low-temperature chambers.

Only a few papers included details of the other parameter ranges. Control of air change rates in the test rooms, which is accomplished through multi- or variable speed fans, ranged from 0 to 36 air changes per hour (ACH) but generally allowed for control within the minimums required by the EN 12931 (0.5–3.6 ACH for residential buildings) [75]

**Table 3**  
Categorization of technological systems and related controlled parameters.

Technological control system for comfort	Controlled parameters
Ventilation and space conditioning	Air temperature Air velocity Air humidity Air quality (gas concentration, air changes per hour)
Heating/cooling surfaces	Envelope superficial temperature Radiator or other element temperature (e.g., clothes, furniture)
Light sources	Illuminance Solar radiation (artificial, e.g., solar simulator) Solar radiation (natural, e.g., actively controlled blinds and shades, electrochromic glass)
Acoustic systems	Background noise level (sound intensity, sound pressure level) Sound typology (soundscape)

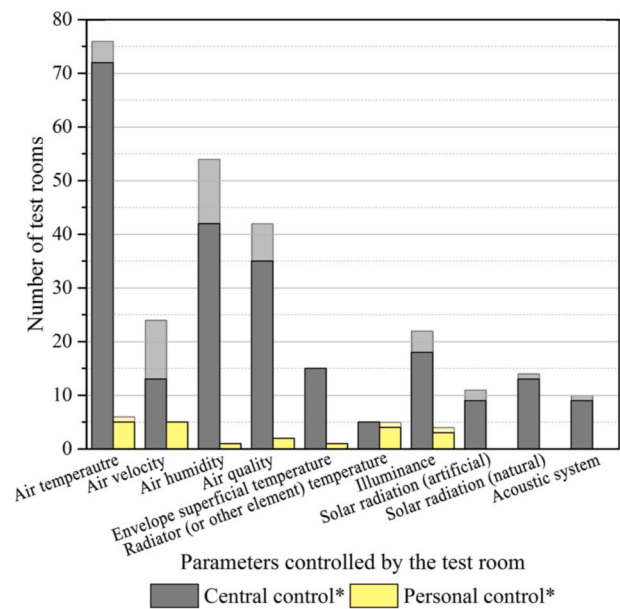

\*lighter colour bars indicate uncertainty: the controlled parameter was not explicitly indicated but deduced by the experiment description in the context of the publication

**Fig. 5.** Frequency distribution of reviewed test rooms which can control the listed parameters.

and by EN 16798 part 3 for offices (1–8 ACH) [76]. Only five test rooms reported the temperature range at which their radiant wall systems (either electric or hydronic panels) could be controlled (generally between 10 and 40 °C). For rooms with reported artificial lighting, the range 100–800 lx covered and exceeded the requirements (e.g., EN 12464) [77]. A few publications also reported the ability to vary the correlated colour temperature of the artificial light (2000 K to 10,000 K). There was insufficient information about artificial solar radiation and acoustic systems to report ranges here.

Only 11 of the reviewed test rooms included parameters that could be controlled at a personal level. Furthermore, most of these personalized systems were only temporary for specific experiments and not a fixed part of the test room. Typical setups would be ventilation tubes aimed at a desktop, heated/cooled clothing and chairs, electrical heated mats or computer equipment (mouse, keyboard), and electrical radiators.

The parameters controlled by the test rooms were also examined based on the estimated date of construction of the test room to identify trends or most prevalent innovative technologies, as shown in Fig. 7. It is also unknown if or when test rooms have been upgraded, nor do we have insight about the upgrades made. Thus, the results in Fig. 7 represent the latest built stage of the test rooms according to the publications and may differ from their technologies at the given date of construction. The graph suggests a trend towards incorporating the control of acoustic sources, artificial and natural solar radiation, illumination, and radiant heat sources, including radiators and radiant wall panels.

Furthermore, the analysis revealed that personalized control systems are becoming popular in newer test rooms constructed after 2000. Finally, in the latest test rooms built between 2011 and 2020, there also seems to be a trend for controlled multi-domain installations with six test rooms since 2013, controlling at least three domains.

### 3.3. Economic investment

The economics of test rooms is rarely reported. Therefore, a survey to assess key elements related to this topic was designed. All co-authors of this manuscript and authors of identified literature were invited to complete it. In total, 18 responses related to separate test rooms were

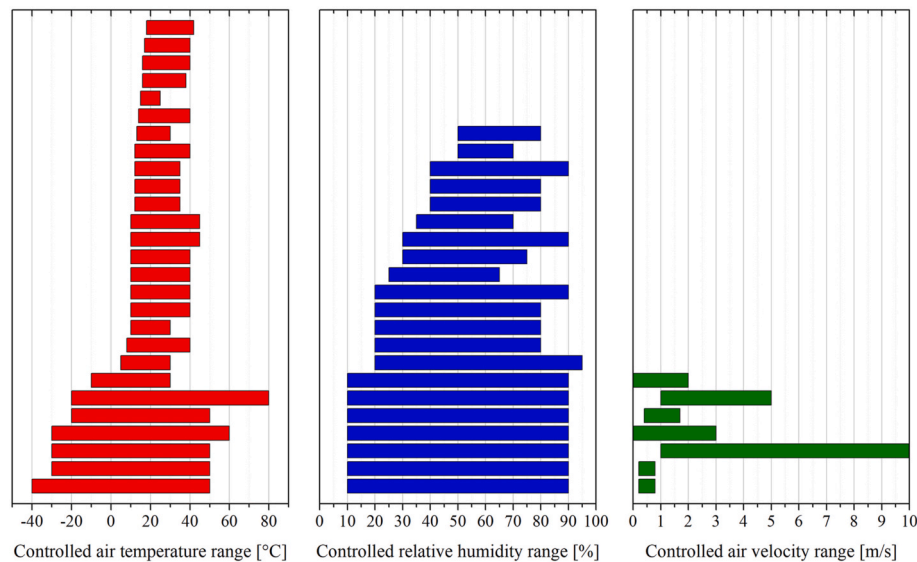


Fig. 6. Ranges of controlled air temperature, relative humidity and air velocity in the reviewed test rooms.

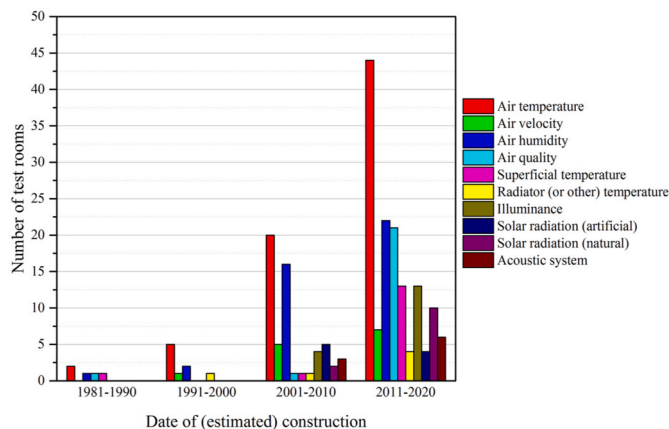


Fig. 7. Time distribution of implemented technologies for controlling specific parameters (see the legend) identifying trends in test room construction.

obtained, of which 14 have been completed, and four are still under construction. Except for one completed in 1990, all others have been built within the last ten years. The majority of the test rooms is either a test room constructed within an existing building ( $N = 8$ ) or a building itself (6). Three test rooms are newly built test rooms within a new building, and one test room is an existing room refurbished and upgraded to serve as a test room. The vast majority is located in Europe (13), followed by Asia (3) and North America (2).

Local currencies have been converted to EURO based on currency rates from September 4th 2020. The total budget ranges from EUR 45,500 to EUR 943,000 (mean = EUR 347,000  $\pm$  299,000, median = EUR 240,000). For eight test rooms, information was provided in more detail. On average, shell construction costs (especially for those test rooms built as stand-alone test rooms within new buildings) are highest (mean = EUR 175,000), followed by costs for design, contracting, and commission (EUR 91,000), heating and cooling system (EUR 31,000 and 34,000), and in-built sensors and the Building Management System (EUR 33,000 and 19,000). This large variety can be explained partly by the variety in the type of construction, controlled and monitored variables and the ranges within which these variables can be controlled. In addition, it can be expected that prices vary locally and between countries. Seven out of 18 test rooms were fully funded by governmental sources, either from basic funding ( $N = 3$ ) or project

funding (4). In addition to public and project funding, five test rooms were partially funded by the industry (min 5%, mean 24%, max 70%).

In addition to initial construction and installation costs, running costs (e.g., electricity, gas, water) and/or maintenance costs were assessed. Running costs were reported solely for three test rooms, but differed largely (EUR 2500 to 17,500 per year). Interestingly, the source of funding for running costs was provided for 14 test rooms, of which nine responded that the university pays for running costs, three state project funding, and the other shared funding either between the university and the lab (10/90%) or the university and project funding (20/80%). The large discrepancy in response numbers between actual costs and funding source may signify that researchers are not aware of the running costs. Maintenance costs were provided for eight test rooms and range between EUR 930 to EUR 10,000 per year (EUR 5100  $\pm$  3500). Funding sources for maintenance costs vary more than running costs for 12 out of 14 facilities, for which such information was provided. In three cases each, maintenance is paid fully from the laboratories' basic funding or project funding. In two cases, the university covers all maintenance costs. In the other cases, maintenance costs were shared between the university, basic funding of laboratory and project funding with varying degrees. Only in one case, 25% of maintenance costs are provided by industrial partners.

### 3.4. Commercial test rooms

Commercial test rooms are available on the market to provide researchers who want to use an already existing and tested product with an off-the-shelf option. These test rooms tend to use a similar structure and envelope materials as prefabricated foam-insulation panels with stainless steel, galvanized or coated aluminium (usually white) interior surfaces for fast and easy installation. This is for protecting the test room surface from being damaged or corroded by moisture and chemicals. The stainless-steel chamber can also help minimize the adsorption of VOCs by the surfaces, which is critical to some indoor air quality studies. However, for human-centred thermal studies, the reflective properties of the interior surfaces also determine the radiative heat exchange in the space, thus additional materials or painting are needed to simulate a 'real-life' condition. The test room usually has at least one hinged door made of the same material and optional windows of different sizes. Important differences between offerings tend to be in the type of airflow achieved in the test room. Cheaper and smaller systems tend to have the heat exchangers inside the room and achieve spatial stability by

producing turbulent flows. More laminar flows are achieved with wall-to-wall or floor-to-ceiling air flows across the whole wall/floor, which requires a plenum space inside the test room, thereby increasing the external size. Most of the rooms come with predesigned and pre-packaged conditioning systems that can provide space heating and cooling, ventilation, humidification, and dehumidification to the room. Air temperature, relative humidity, and ventilation rate are under control and monitored. Some test rooms are even equipped with pressure,  $\text{CO}_2$ , and  $\text{O}_2$  sensors.

The operating condition of commercial test rooms depends on their application that can be testing equipment, storing experimental materials, and also human-centric tests. Here, since we only focus on the test rooms for the human-centric test, the surveyed test rooms only include those capable of providing conditions indicated by the green box in Fig. 8.

These commercial test rooms can be as small as  $1.5 \text{ m}^2$  and as large as up to  $10 \text{ m}^2$  with a height in between 2.4 and 2.6 m. The price of the test rooms ( $N = 13$  units personally contacted by the authors) ranges from EUR 54,600 to 210,000. The average quote from U.S. companies is

around EUR 128,100 with a standard deviation of EUR 44,000, while the average quotation from Europe is around EUR 99,800 with a standard deviation of EUR 27,400. On average, the test rooms from the U.S. (8) are a little more expensive than in Europe (5). The explanation may include regional reasons such as shipping and labour, material and sensors cost, and size difference. One should note that the size and quotes obtained in this study are based on the smallest test room with the basic features of temperature, relative humidity, and ventilation control with at least one occupant. The quotes were obtained in August 2020, and for the commercial test rooms made in the U.S., the quote was converted to EUR based on the exchange rate on September 4th, 2020 [ $1 \text{ USD} = 0.84 \text{ EUR}$ ].

#### 4. Test room experiments on human-environmental comfort

This section focuses on the experiments conducted in the test room above presented in terms of their structure and main functionalities. Each subsection presents an overview of the main aims and procedures of test room experiments answering the question, what is the scientific

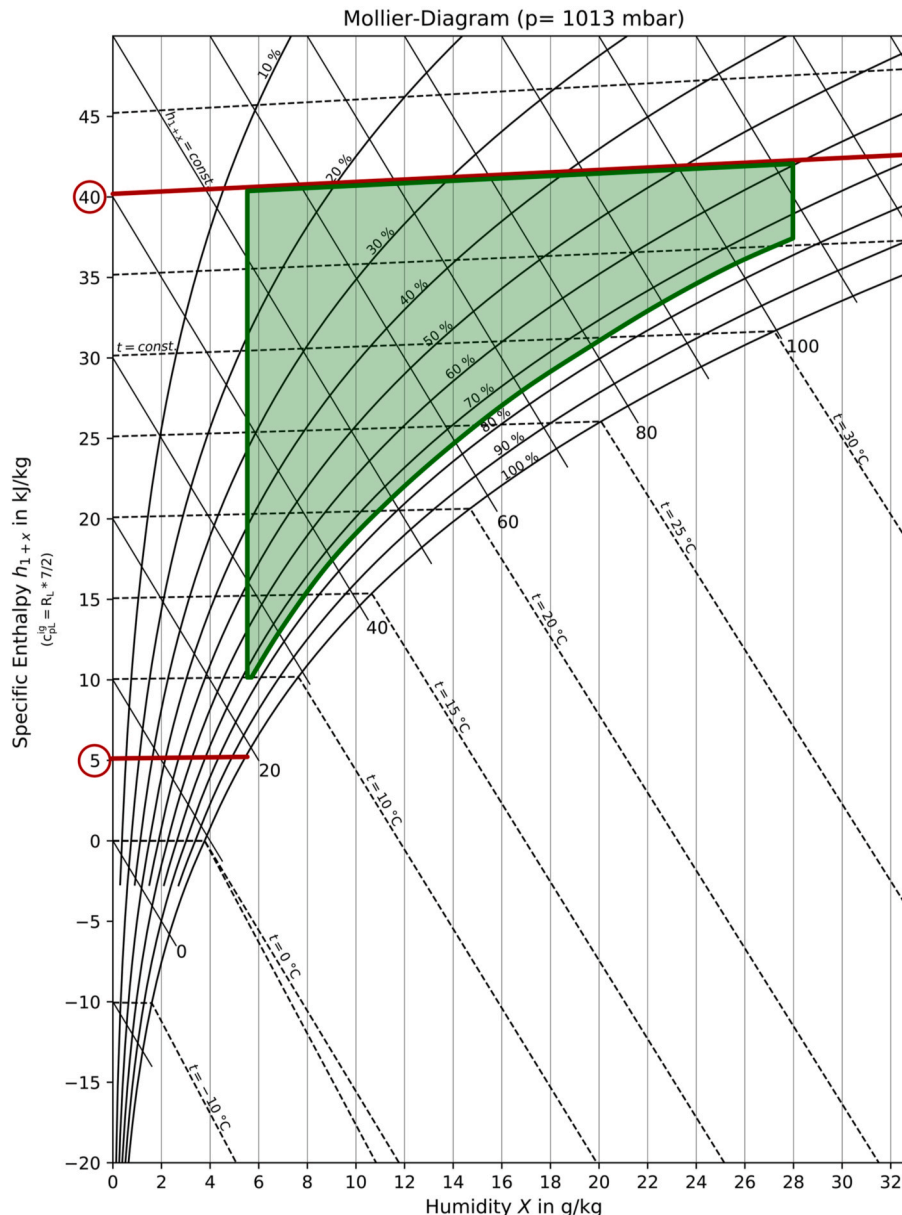


Fig. 8. Required operating conditions of the surveyed commercial test rooms.



community looking for through test room experiments? Scopes of the experiments are broadly clustered in the presented subsections with respect to (i) the comfort domain of interest (sections 4.1–4.5), (ii) the subjects' involvement (possibility to interact with the test room during an experiment, section 4.6), and (iii) the investigation of the energy related aspects (section 4.7), which are all relevant aspects for human comfort studies. Concerning the applied procedures, the main distinction is adopted between stationary and dynamic conditions.

#### 4.1. Thermal-only experiments

This subsection reviews 204 papers on test room studies that explored the effects of thermal conditions on participants. The scope of the reviewed thermal experiments can be broadly classified into three categories: (i) fundamental research aiming at providing a better understanding of human thermal comfort; (ii) technology-oriented experiments, whose purpose is to test the thermal comfort performances of specific types of heating and/or cooling systems or newly developed clothing; (iii) predictive studies with the purpose of data collection to test and train novel predictive models. Fundamental studies are more common than technology-oriented and predictive studies, respectively 57%, 36% and 7%, and their distribution over the last four decades is shown in Fig. 9a. Fundamental studies include research focusing on a variety of different aspects influencing human thermal comfort such as thermal adaptation [78–82], thermal acclimatization [83–86], increased air velocity [87–90], relative humidity [60,91–94], gender [95–98], age [52,99–102], transient thermal conditions [93,103–107], perceived control [108], and the influence of emotional states [109,110]. About 30% of the thermal experiments are dedicated to the study of non-uniform thermal conditions. Non-uniformities and thermal asymmetries are not seen only as a cause of discomfort; indeed, many recent studies aim to understand how comfort can be enhanced with local thermal stimuli [111–120].

The technology-oriented experiments mainly look at the thermal comfort performances of specific types of equipment, such as innovative heating and/or cooling systems (thermo-electric air cooling systems [38,121], stratum, mixing and displacement ventilation [122–124],

underfloor air distribution systems [122,125], radiant cooling/heating panels, floors and ceilings [126–129], ceiling fans [130], etc.). In particular, the last 20 years have seen a progressive increase in the number of experiments dedicated to local heating and/or cooling systems (personal cooling with phase change materials [112,113], heated/cooled chairs [114–116], seats heated with encapsulated carbonized fabric [120], feet heaters [117,118], etc.). About 40% of the technology-oriented experiments aim to test new clothing (uniforms for heat strain or cold thermal stress attenuation in the construction industry [50,51,131,132], sports clothing [53,133–135], protective clothing systems [136,137], cooled/heated garments [138,139], etc.). The distribution of the technology-oriented experiments based on the type of system studied (heating or cooling, local heating and/or cooling, clothing) over the four different climate groups is shown in Fig. 8b. As expected, in tropical climates there is a prevalence of experiments studying cooling systems, while in continental climates, the focus is on new clothing systems.

The predictive studies provide experimental data to either develop, test and train novel data-driven predictive models. Many of them aim to predict either thermal comfort or thermal stress (e.g., heat strain indexes [140,141]). Instead, others are attempting to build models for predicting metabolic rate and clothing insulation levels [64,142].

A majority (46%) of the reviewed thermal experiments deal with both warm and cold thermal conditions, 39% of them only focus on warm conditions and the remaining 15% on cold conditions. They mainly consider sedentary activity levels (77%), only a few of them focus on high metabolic rate activities (21%) and a minority on sleeping (2%). Furthermore, most of them consider stationary thermal environments, while the experiments dealing with dynamic conditions mainly study step-change transients [93,103–107]. In the last 20 years, female and male participants have been equally represented in the thermal experiments; nevertheless, elderly and children continue to be under-represented groups (in only 3% of the experiments). Concerning the sample size, a majority of the experiments (57%) employ between 10 and 50 participants, 31% of them recruit less than 10 participants, and only 12% more than 50 participants. In most of the experiments (about 70%), participants are passive recipients of thermal stimuli without any

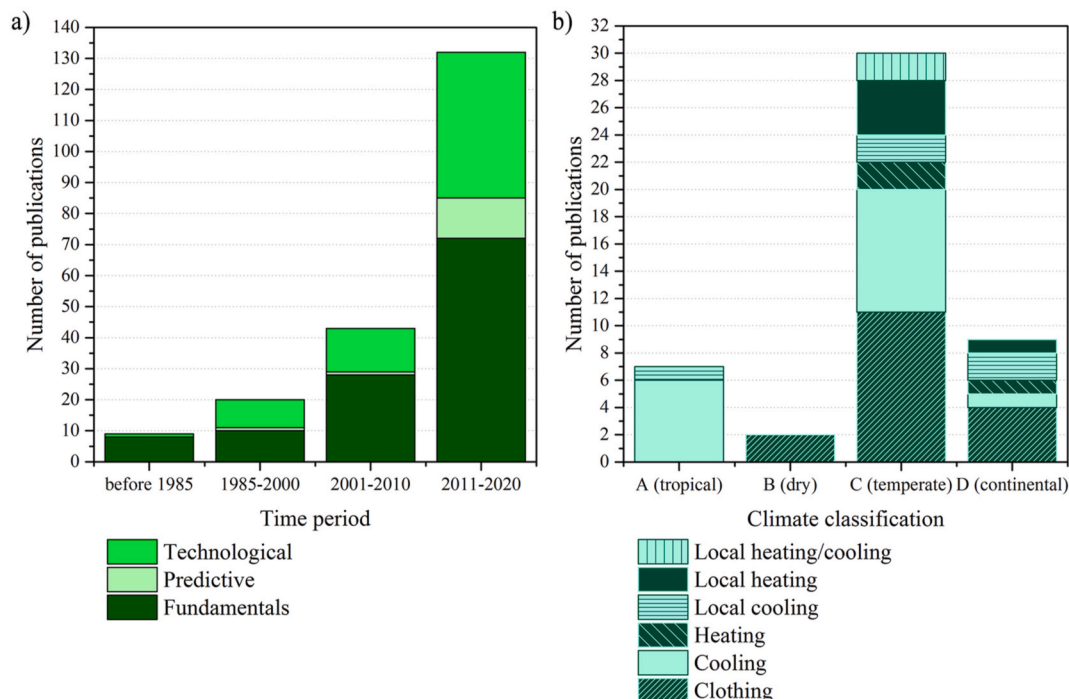


Fig. 9. (a) Thermal studies aim distribution over time periods; (b) thermal technology-oriented studies, studied system over climate classification.

possibility of adaptation/control.

The ASHRAE 7-point thermal sensation scale is the most used metric of thermal perception, followed by thermal comfort, thermal acceptability, thermal preferences, and cognitive performances. Air temperature is the most frequently monitored environmental variable (in 90% of the experiments), followed by relative humidity (75%), air velocity (63%), globe temperature (36%), and wall surface temperatures (9%). Air turbulence intensity, luminance, and solar irradiation (artificially provided) are more rarely monitored. Oxygen and carbon dioxide measurements are mainly used to estimate the metabolic rate, less often as a proxy of air quality. Skin temperature is the most common personal measurement (60% of the experiments), followed by heart rate/heart rate variability (27%), rectal/body core temperature (18%), body weight for sweat rate determination (7%), skin wetness (6%), ear/oral temperature (5%), skin surface blood flow (4%), blood pressure (3%), and skin heat flux (2%). Some very recently emerging topics are the use of immersive virtual reality [143–145] and the monitoring of brain electrical activity patterns [109,146].

#### 4.2. Acoustic-only experiments

This subsection looks at 11 test room studies exploring the effects of acoustic conditions on participants by investigating different human responses and developing or evaluating new metrics for soundscapes description (Fig. 10). The test room experiments' aims include investigating maximum heavy-weight impact sound levels for perceived comfort [147], effects of sound pressure levels (SPL) and sound types on children's task performance [148], factors that contribute to sound complexity [149], effects of speech noise and speech transmission index (STI) in offices on cognitive performance [150,151], suitable masking sound frequency distribution for offices [152], effects of low-frequency noise in offices [153], effects of various noise sources on occupants in multi-family buildings [154], useful acoustic parameters that effectively describe to perceived sensations of urban sounds [155,156], and effects of introducing natural sounds to urban noise [157].

Many of the studies followed the general procedure of exposing participants to stimuli (recordings of sounds at various SPLs, frequencies, or decay rates) while performing cognitive tests and/or completed subjective assessments of the acoustic environments.

Test room setups and specific data collection procedures varied considerably among the studies. For instance, the provided stimuli length ranged from 10 s to 45 min, and the time that participants were given to respond to objective and subjective assessments ranged from 5 s to as long as the participants wanted to take. Most of the studies used loudspeakers to play the studied sounds, except Hermida and Pavón

[156] and Hong et al. [157], who used headphones, and Jeon et al. [147], who used both loudspeakers and headphones. Only three studies [150–152] had test room setups that mimicked the type of real-world environment that they were investigating. Concerning the overall environmental control, three studies [150,152,153] mentioned that other indoor environmental conditions (such as temperature and lighting level) were kept constant in the test rooms. In contrast, others did not give any description of non-acoustic environmental conditions in the test rooms that could potentially affect the study outcomes.

For acoustic experiments involving human participants, it is common practice to screen participants' hearing abilities before conducting listening tests to avoid bias in the perception analysis. However, only four studies [147,149,153,157] screened their participants' hearing abilities using audiometers and other devices, and three studies [148, 152,155] used subjective assessments to determine hearing abilities. Other studies either did not do similar screening or did not specify how they determined participants' hearing abilities. In addition, only three studies included evaluation of the effects of demographics, for example, age [147,148,150] and gender, and personal factors, such as personality traits [150], on participants' responses. Finally, just one study [153] monitored the physiological responses of participants (including the electrical activity of the brain, eye activity, heart rate, and heart rate variability) to low-frequency sound exposure using electroencephalography (EEG), electrocardiogram (ECG), electromyography (EMG), and electrooculography (EOG) signals.

Regarding sample size, six out of the 11 reviewed studies involved between 10 and 50 participants, with a minimum of 23 [152], while all the others involved more than 50 participants up to a maximum of 290 [148].

#### 4.3. Visual – lighting-only experiments

The following overview focuses on visual-related experiments aiming at studying subjective evaluations of the visual environment performed in controlled environments. Studies conducted with the use of a scale model (e.g. Refs. [158–160]), with a small apparatus (e.g. Refs. [161–163]), in a booth (e.g. Ref. [164]) or in virtual reality (e.g. Refs. [165,166]) were excluded from the analysis as they were not performed in real-scale controlled environments. Investigations on electric lighting evaluations primarily aiming at testing lamp brightness and colour rendition based on lamp characteristics (e.g. Refs. [167–170]) were also not included. The resulting sample analysed consisted of 70 papers.

As introduced in Section 2, visual-related studies in controlled experiments have increased over the last decade, with more than 77% of

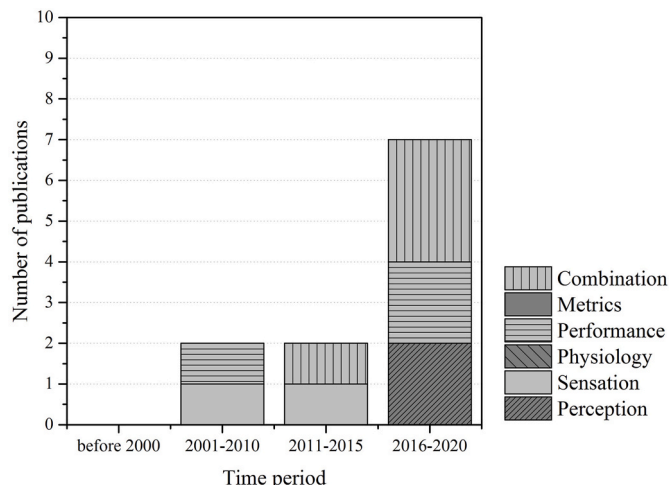


Fig. 10. Distribution of acoustic studies' aim over time.

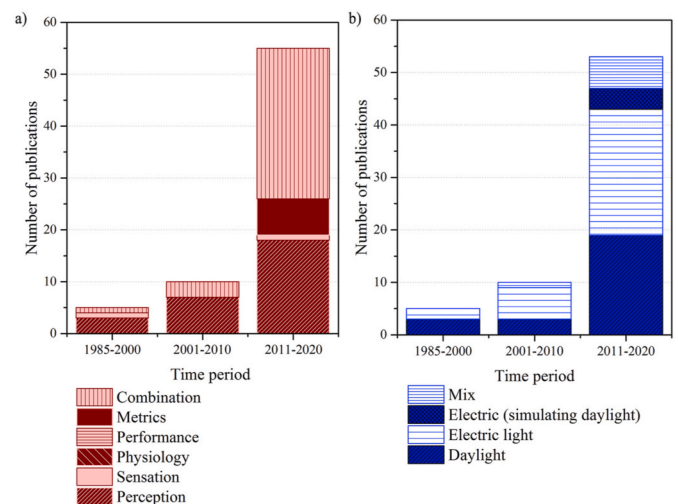


Fig. 11. (a) Distribution of visual studies' aim over time; (b) investigated light source distribution over time periods.

the considered studies conducted between 2010 and 2020 (Fig. 11). The type of light source investigated has been relatively constant throughout the years, with an equal number of studies focusing on electric light and daylight (Fig. 11b). The majority of studies focused on glare (more than 50%), either to evaluate subjective perceptions due to variations of lighting conditions or other factors' influences (such as time of the day or openings and blinds features) [21,22,37,39,42,66,171–182], develop, evaluate or validate metrics, thresholds or indexes [35,68,183–193], investigate glare influence on performance and physiology [187,194–196] or study a combination of such objectives (Fig. 11a). Other studies investigated visual perceptions of the visual environment, surface finishing preference, physiological responses, performance, sleepiness, vitality, arousal, tension, mood, self-control and cognitive-biological processes (light-reactive hormones of melatonin and cortisol) mainly related to the light quantity and correlated colour temperature (CCT), but also in relation to light uniformity, wall luminance, light source type, flicker rate, view and chromatic glazing [164,197–216]. The majority of the studies did not allow for personal control of the environment, testing pre-defined conditions, and were conducted with 10–50 participants. Only in a few studies participants were requested or simply allowed to vary their visual environment through the operation of blinds and electric lights, either to evaluate glare conditions or to assess how occupants perceived their visual environments associated with diverse luminous ambiances created by daylight in apartment buildings [73,189,191].

Most of the investigations were conducted in re-configured office spaces located in existing buildings, transformed into experimental test rooms in which it was possible to control or at least measure visual parameters. The traditional configuration was a side-lit single office, generally bigger than 20 m<sup>3</sup>. Still, some investigations used a corner office [193], a mock-up of an open-plan office with multiple workplaces [209], a re-configured classroom [66], a full-scale mock-up conference room [208], or divided an existing office room with internal vertical partitions, resulting in smaller experimental spaces [217,218]. Some glare experiments used full-size apparatuses consisting of a semi hexagonal lighting chamber equipped with a chin rest [22,172,173,176] or of a semi-spherical screen with two halogen lamps mounted on a 1-m radius round boom [21,185]. Only fewer studies were conducted in a stand-alone test room, either located indoor [197,198,200–204,210–213,219] or outdoor [35,42,179,188,192,194,220,221]. Some of the outdoor facilities were rotating structures [35,179,192,195,220], allowing daylight conditions to be tested with a reduced impact of the daylight variations due to the season and time of the day. Very few test spaces were designed to have a side-by-side configuration with two identical spaces, one for participants and the other for measurements [35,171,183,187,189,190,194,220]. This particular setting, aiming at decreasing interventions in lab experiments, is particularly suitable for visual-related investigations as photometric data are relatively affected by the presence of people, contrary to the other indoor factors that have to be measured close to participants. The presence of a window to the outdoors was linked to the type of experiment investigated. Almost all experimental spaces provided with a window investigated daylight, except for those studies that performed the experiments at night [222] or in which windows were shaded with a black-out fabric or blocked [164,180,199,207,217]. The studies investigating a mix of daylight and electric light were provided with shading devices [189,190,205,220,223]. On the other hand, not all the studies on daylight were provided with a real window to the outdoor (intended as an opening with a view), but used artificial windows [37,177,181,192,204] or anidolic systems on the southern façade [224]. Non-visual factors were measured, controlled, or balanced across experimental conditions in almost all stand-alone test room experiments, and only in fewer re-configured offices [199,205,217,218,223,225]. The factors considered were primarily air temperature and humidity, but also noise [217,218] and air quality [37,197,198].

#### 4.4. Air quality-only experiments

This subsection describes the controlled air quality-only experiments in test rooms summarised in 18 papers according to the reviewed database. Additional four papers that fall under two-domain experiments are included in the analysis since thermal and air quality aspects are hard to disentangle as the thermal analysis is ancillary to the air quality assessment [72,226–228]. Among the representative selections of 22 air quality studies in test rooms, researchers have focused on the three main topics: (i) understanding perceived air quality, productivity and health under a range of environmental parameters [71,72,229–235]; (ii) human inhalation exposure and spatio-temporal variation of air pollution in a space [20,228,236–241]; and (iii) airflow distribution in occupied spaces and ventilation effectiveness [226,227,242–244] (Fig. 12). These topics were pursued through a combination of questionnaire surveys, environmental measurements (near a study participant, in bulk air or ventilation ducts), and physiological measures. Discrepancies in facilities among the selected studies include test room layouts (office space, classroom, aircraft cabin, hospital room), test room volumes (small below 10 m<sup>3</sup>, medium 10–50 m<sup>3</sup>, or larger than 50 m<sup>3</sup>), surface materials (stainless steel, polytetrafluoroethylene, aluminium, glass or their combination), type of air pollutant generation (continuous or episodic), ventilation type (mechanical or mix-mode ventilation), ventilation strategy (mixing, displacement, underfloor or personalized ventilation), degree of air mixing (ventilation only or additional use of mechanical fans), operating procedure (dynamic or stationary conditions), and participant type (real occupancy or use of breathing thermal manikins).

In the reviewed air quality papers, all test rooms were located inside of the building and had control over the ventilation rate, air temperature and relative humidity. While nearly all studies reported air temperature and relative humidity values and associated uncertainties, only 12 out of 22 studies reported air change rate values (mean = 3.89 h<sup>-1</sup>), out of which only three described the method of estimation [237–239]. These studies used the tracer gas decay method by means of low adsorption tracer gases such as CO<sub>2</sub>. The majority of the selected studies were performed in test rooms larger than 20 m<sup>3</sup> (mean floor area = 30 ± 27 m<sup>2</sup>), which is important for mimicking various indoor layouts occupied with people and for studying air contaminant distribution in the space. Twelve studies focused on mimicking office environments, whereas other studies focused on aircraft (2), classroom (1), hospital (1) and other unspecified environments (6). Studies involving perceived air quality, Sick Building Syndrome (SBS) symptoms and productivity under variable levels of gas-phase pollutants [71,72,229–235] had a significantly higher number of study participants (76 ± 9.3) compared to studies focusing on human inhalation exposure and spatio-temporal variation of indoor air pollutants (8.2 ± 13.6) [20,

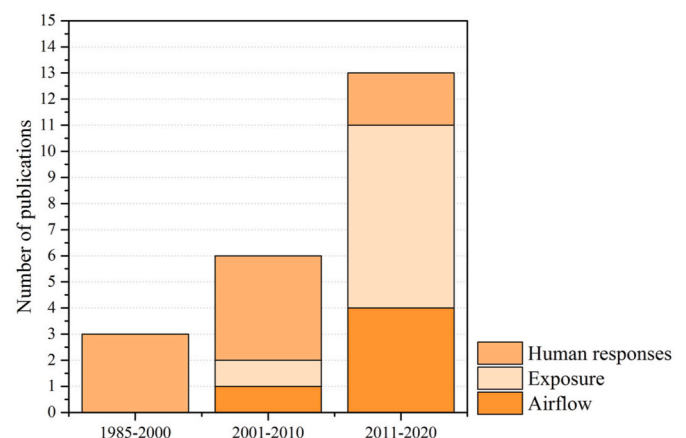


Fig. 12. Distribution of air quality studies' main topic over time.

228,236–241] and airflow distribution in occupied spaces and ventilation effectiveness ( $2.3 \pm 2.1$ ) [226,227,242–244]. The majority of studies focused on measurements of CO<sub>2</sub> (9), followed by VOCs (7), particulate matter (4), and other inorganic gasses such as NO<sub>2</sub>, N<sub>2</sub>O, O<sub>3</sub>, and CO. Measurements of these air pollutants were performed with scientific instruments, which were not an integral part of the test rooms. None of those studies reported the adoption of the optimal inner coating of the test room surfaces, which is essential to determine how these coatings influence heterogeneous reactions with volatile organic compounds and other gaseous pollutants. Among the selected papers, only a fraction (2) reported issues that could arise due to pollutant uptake or emissions in the test rooms. Furthermore, in all studies, there was a lack of integration between advanced online and offline instrumentation and analytical techniques within the test rooms.

#### 4.5. Multi-domain and whole comfort experiments

The goals of a multi-domain experiment can be categorized into (i) evaluate the effect of specific building technologies or control strategies on occupant multi-domain comfort [119,245–250]; (ii) understand cross-modal and interaction between different domains [46,72,251–268]; (iii) model the physiological [97,100,228,269,270] or behavioural [271–273] response of occupant to combined multi-domain stimuli and to understand the effect of IEQ on stress [274,275]; (iv) identifying new multi-domain metrics such as air enthalpy [251], air distribution index [276] and bio-signals such as skin temperature [277] for the whole comfort. In some cases, the energy consequences of such multi-domain interactions are also captured, as for the studies investigating novel personalized thermostats [272,278,279] or novel visual comfort systems [39,45] to improve energy efficiency and comfort. Among the studies focusing on the effect of specific building technologies or control strategies on occupant multi-domain comfort, the development of novel personal comfort systems in buildings [113,116,245,246,248,280–286] and vehicles [118] has received particular attention.

The interest in studying occupant response to multi-domain stimuli has increasingly grown since 2000, especially after 2010. Multi-domain experiments constitute 23% of the overall 396 occupant comfort experiments in test rooms, as given by the review database. Most of these studies investigated the relationship between two physical domains, while studies focusing on three or more physical domains were just 4% of the whole database. In terms of investigated combinations of domains, thermal and air quality represent the most studied one, followed by thermal with visual and thermal with acoustic (Fig. 13).

The majority of the studies were conducted under stationary conditions, while only a third of the studies exposed occupants to changing


environmental or dynamic conditions. Dynamic conditions were achieved either by step changes in indoor conditions [246,248,251,257,274,287–289] or, especially concerning thermal-related studies, by fast and long changes [79,265,275,290], meaning that a rate of change greater than 2 K per hour is provided for more than 1 h of exposure. Only a few studies investigated multi-domain effects under high-speed conditions [91,250,291] or slow and long dynamical changes [263,271,292].

In addition to highly accurate monitoring of environmental parameters, most studies capture occupants' responses as a combination of subjective and physiological parameters. Nearly half of the studies (53%) relied only on subjective occupants' responses. Table 4 shows the subjective metrics and physiological parameters monitored in the experiments. In terms of subjective measurements, based on survey or behavioural observations, environmental sensations are the most employed, followed by environmental preference and acceptability. In terms of physiological parameters, skin temperature and heart rate are the most monitored ones, also due to the thermal domain being investigated at least in 94% of the overall multi-domain experiments. Lastly, the use of EEG, ECG, and EDA has just recently started to be adopted, mostly after 2015, to understand multi-physical occupants' responses in test rooms, especially when investigating interactions between different comfort domains.

**Table 4**

Different approaches for capturing occupants' responses in multi-domain experiments in test rooms.

Occupant response		References
Subjective (survey based or from behavioural observations)	Environmental sensation	[44,46,47,60,67,78,79,85,86,89–91,99–101,118,120,122,124–126,245,250,253,256,257,264,267–269,273,275–277,290–297]
	Environmental comfort	[44,47,60,72,85,89,91,99,100,118,120,122,125,245,252,253,267–269,291,294,296–299]
	Environmental preference	[44,47,79,86,99,102,122,248,252,253,257,267,268,291,295,297]
	Acceptability	[47,85,86,91,122,124,248,249,253,275,294,295,297]
	Environmental satisfaction	[46,78,252]
	Emotion response	[46,264,289]
	Alertness	[50]
	Stress level	[274]
	Work performance	[90,268,273,275,289,294,295]
	Clothing level	[125,249,261,269,277]
Physiological parameters (sensing device based)	Skin temperature	[44,46,79,86,99–102,117,120,125,253,258,259,292,300]
	Skin moisture	[301]
	Core temperature	[86,102,258,259]
	Electrodermal activity (EDA)	[44,46]
	Electrocardiogram (ECG)	[47,100,294]
	Electrooculography (EOG)	[297]
	Electroencephalogram (EEG)	[47,274,289,294,297]
	Acceleration	[46,302]
	Heart rate	[44,46,266,289,292,303]
	Nasal dimension by acoustic rhinometry	[301]
	Photoplethysmography	[302]
	Metabolic rate	[277]
	Frequency of blinking	[303]
	Mucociliary transport	[303]
	Saliva and tear mucus film samples	[295]

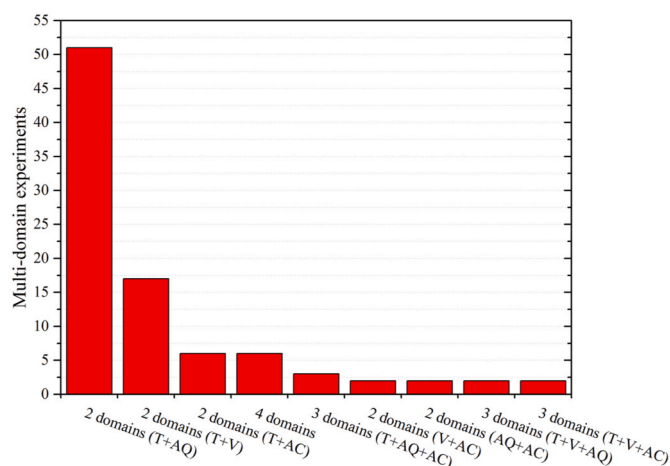

**Fig. 13.** Multi-domain experiments by combination of each domain.



#### 4.6. Participants interacting with the environment

This section focuses on those experiments whose protocol allowed participants to freely interact with the test room components and systems. The interactions taken into account for this further classification include adjusting settings of the test room conditioning system, dimming/switching lights, opening/closing windows and shading systems, adjusting personal comfort devices. According to the reviewed scientific publications, this section is based on 21 papers (see Table 5). Nine of those 21 have been published in 2018–2020, and ten originate from European universities or institutes.

Two papers describe a test room facility developed and constructed to test all environmental factors (lighting, acoustics, air, and thermal quality) [43,304], including interactions with the environment through design and systems, making it possible to provide both input data to and output data from the occupants. Most of the publications were concerned with thermal quality in relation to thermal comfort, sensations and/or preferences [102,124,305–307], in combination with (personal) control [36,111,281–283,308,309], together with air quality [232] or visual quality [45,310]. The latter was studied in three reported studies [73,189,191], of which one was concerned with daylight, glare, shading and control [73]. Only one study included all the IEQ aspects [311].

The participants involved in the different studies mostly comprise of students and healthy young adults. Only one study was concerned with children (primary school children with an average age of 10 years) [311]. One study included a comparison between young (average 23 years) and older males (average 67 years) [102], and one study looked at the impact of ethnicity [309]. In most publications, the responses or interactions of a participant with an object or variable/parameter in the environment are reported. The studied controlling devices varied from (local) heating or ventilation devices [283], light dimmers [310] or blind/solar shading control device [73], wearable conditioning devices [111], and furniture [281]. Table 5 summarises the 21 papers concerning those experiments where the building occupant is able to interact with the test room in the form of personal judgments or specific actuator-to-reaction.

#### 4.7. Energy-related human comfort experiments

Out of 396 reviewed papers, 85 considered energy-related issues while carrying out thermal-, visual-, indoor air quality-, and acoustic-related experiments. Of these, 28 papers had a multi-domain focus with 22 papers considering both thermal and air quality-related experiments, five papers presenting thermal- and visual-related experiments [97,232,281,312–314], and only one paper discussing the effect of personal control on thermal, visual, and air quality perceived by building occupants [310]. Among the single comfort domain studies, thermal investigations are by far the most widely carried out (50), followed by visual investigation (5). Olfactory and aural comfort were studied together with energy considerations in just one article each [156,232].


The first document of the database was published in 1978. For the following 30 years, much slower growth was observed in the number of publications on energy-related human comfort experiments. After 2008, the scientific interest in this topic has progressively increased because of the increasing research interest in human-centric building design [315], personalized control strategies [316], and perceptual and behavioural environmental studies [32] (Fig. 14).

The majority of experiments have been conducted in test rooms located inside buildings with controlled environmental conditions, and only three experiments were run considering the actual outdoor weather [46,97,312]. Furthermore, 45 experimental procedures employed dynamic conditions and 32 studies used steady-state conditions. Dynamic studies are generally more recent (the average publication year is 2013), while steady-state conditions are more common in older studies (the average publication year is 2011); this can be explained by the recent

**Table 5**

List of reviewed studies concerning human comfort experiments in test rooms where the participants could directly interact with the facility.

Year pub.	Investigated domain	Studied parameters/object	Interaction between the participant and the test room	Reference
1991	Thermal	Adjust ambient temperature	Adjustment of test room temperature	[307]
1995	Thermal	Two age groups	Adjustment of test room temperature	[102]
2000	Thermal	Adjusting air movement (supplied via ceiling)	Adjustment of the Personal Comfort System (PCS)	[308]
2007	Thermal	3 task air-conditioning systems	Adjustment of the Personal Comfort System (PCS)	[306]
2009	Thermal	Control of 2 fans at chair (under seat, behind backrest)	Adjustment of the Personal Comfort System (PCS)	[282]
2009	Visual	Dimming of light; airflow from ceiling-based nozzle	Adjustment of the Personal Comfort System (PCS)	[310]
2012	Thermal	4 fans at corners chair to enhance displacement vent	Adjustment of the Personal Comfort System (PCS)	[124]
2012	Thermal & Air quality	Air movement (air terminal device), air pollution, temperature and RH	Adjustment of the Personal Comfort System (PCS)	[232]
2012	Visual	Artificial lighting and blinds control, daylight	Adjustments of shading system	[73]
2014	Thermal	Ceiling fan	Adjustment of shading system, ceiling fan, operable windows	[36]
2014	Visual	Daylight	Adjustment of shading system	[189]
2015	Thermal	Heated/cooled chair	Adjustment of the Personal Comfort System (PCS)	[281]
2018	Thermal	Control of personalized heating system	Adjustment of the Personal Comfort System (PCS)	[283]
2018	Visual & Thermal & Air quality & Acoustics	Facades, controls, interior, etc.	Adjustment of shading system, façade properties, thermal settings	[43]
2018	Visual & Thermal & Air quality & Acoustics	Walls, lighting, sound, thermal, air, interior, etc.	Control of HVAC and lighting system	[304]
2019	Thermal & Visual	Windows, blinds and ceiling lights	Adjustment of desk light, ceiling light, solar shading, operable windows	[45]
2019	Visual & Thermal & Air quality & Acoustics	IEQ in their own classroom	IEQ problems in classrooms and solutions for those problems	[311]
2020	Visual	Daylight, glare, shading	Adjustment of shading system	[191]
2020	Thermal	Thermal sensation, thermal preference	Adjustment of the Personal Comfort System (PCS)	[305]
2020	Thermal	Wearable wrist devices for warming or cooling	Adjustment of the Personal Comfort System (PCS)	[111]
2020	Thermal	Self-selected air temperature, thermal sensation, comfort and preferences; skin temperature	Adjustment of the personal comfort system	[309]

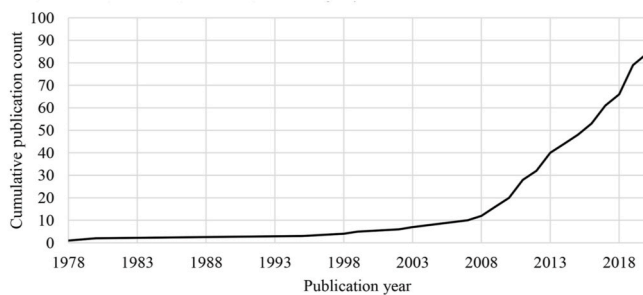

**Fig. 14.** Cumulative number of publications describing energy-related issues in human comfort experiments in test rooms.

availability of easier and user-friendly control interfaces and power modulation for electric motors and pumps.

Regarding the technical systems used during the experiments, only considering the documents where this information was expressed, most of the investigations used air-conditioning systems and only a few tested hypotheses under radiant systems (9 papers), controlled mechanical ventilation (8), artificial lighting (10), and sound equipment (1) [156]. Additionally, 38 papers reported experiments, which adopted personal environmental control systems, which are effective means of testing energy-saving control strategies and are well received by the occupants.

## 5. Summary of key findings

This review analysed a wide range of test rooms for the experimental investigation of human comfort indoors and provided an overview of scientific experiments that are conducted in such facilities and that were published in scientific papers. All reported information was deduced from reviewed papers. According to such an approach, it has to be mentioned that experimental facilities may exist which have not (yet) published any results in peer-reviewed journal articles. The reason may be because (i) it is too new to present results, or (ii) the facility is dedicated to industrial or other research not meant for public sharing of results. This limitation may affect some of our conclusions. Nevertheless, while accepting this limitation, we believe that the number of facilities not included in our review is small due to the two search strategies applied and that the knowledge generated in those facilities not publishing their work, for one reason or the other, is in any case not directly available for the scientific community and less suitable to enhance human comfort theories.

A general observation pertains to the growing number of such facilities. The total number of 187, specifically referred to in the present contribution, is about eight times higher than the number of comparable facilities before 2000. However, the geographic distribution of these facilities does not reflect the variance of climatic regions around the world: 82% are located in moderate climatic regions. Notwithstanding, the increasing number of test rooms may reflect the growing realization of the influence of indoor environments on human health, comfort, and productivity. This trend is reflected in the increasing number of publications reporting research conducted in these facilities. In this review, a total number of 396 publications were considered.

Looking at the publications from a topical standpoint reveals the scientific community's primary interest in human thermal comfort (204 papers), followed by energy-related studies (85), visual comfort (70), air quality (18), and acoustic comfort (11). Roughly a quarter of the reviewed publications explored indoor-environmental exposure situations involving more than one domain. Only a small number of publications (21) investigated circumstances in which participants could assume an active role and had the opportunity to interact with relevant features of the indoor environment.

Our findings suggest that about 92% of the test rooms were built inside of a building. This is interesting: while the performance

characterization of building components has mainly been tested in outdoor testing facilities [317], the investigation of indoor comfort has been conducted either in actual occupied buildings or in dedicated test rooms located indoors with potential better controlled experimental procedures and microclimate conditions. However, based on the reviewed publications alone, it is not possible to draw up a more detailed picture of the test rooms' design and construction. For instance, in 47% of the reviewed publications, it was not possible to ascertain whether the test room envelope entailed any type of openings. Lack of such details makes it difficult to independently replicate and subsequently validate the results coming from experiments in test rooms. Our review also addresses another critical point: there is a lack of information regarding investment, operation, and maintenance costs associated with the facilities. A dedicated survey designed and distributed on our side received responses only from 18 facility owners or operators, pointing to the need for further efforts in the transferability of know-how with the test rooms.

Certain observations apply to studies that focused exclusively on thermal comfort: studies on fundamental issues dominate in this area (57%) versus technology-oriented (36%) and predictive studies (7%). An increasing number of experiments in the last 20 years focus on local heating/cooling systems. A large share of technology-oriented studies (40%) focuses on developing new, insulating, and thermally active clothing. This may indicate a shift in the industry from the traditional room-air-conditioning design perspective to a more personalized thermal comfort approach. The majority of the reviewed studies were conducted in office-like environments with small samples (10–50 people) engaging in sedentary activities. Few papers focused on the elderly or children (3%), and in 70% of the studies, participants were passive recipients only. Some studies introduced new, recently emerging methods such as immersive virtual reality and monitoring of brain activity patterns.

Studies related to acoustic comfort mostly followed a general procedure where participants were exposed, on a short-term basis, to stimuli while performing cognitive tasks or completed subjective tests. Interestingly, only four studies (less than 40%) screened the hearing abilities of the participants. This may have introduced bias in their results.

Studies on lighting and visual comfort significantly increased in the last decade, addressing both daylight and electric light: their bulk is concerned with glare problems in the workplace, primarily deal with glare perception and entail the development and evaluation of related metrics, thresholds or indexes. The investigations also pertain to various human responses related to light quantity and CCT. Most of these latter investigations focused on the non-image-forming effects of light. Only a few studies allowed participants to change the visual conditions by interacting with blinds and electric lights.

IAQ-related studies mostly addressed three topics, namely the perceived air quality's impact on productivity and health, the spatio-temporal variation of air pollution and inhalation exposure, and the airflow distribution and ventilation effectiveness. Some reviewed publications did not report the experimental conditions (e.g., ventilation rates) in detail. In contrast, none of the studies reported surface materials, which is essential concerning how they influence heterogeneous reactions with volatile organic compounds and other gaseous pollutants. The majority of the studies were conducted in sufficiently large test rooms, hence allowing for the consideration of realistic room layouts and air contaminant distribution patterns.

About investigations of multi-domain exposure situations, thermal and indoor air quality represent the most frequently studied combination, followed by thermal-visual and thermal-acoustic combinations. Only one-third of the studies exposed participants to dynamic environmental conditions. 53% of the studies relied solely on subjective responses. In the last few years, a new trend can be seen in the related scientific literature, whereby diagnostic methods from neurophysiology (such as EEG, ECG and EDA) have been applied to explore multi-domain

exposure situations.

## 6. Research gaps and future trends in test room experiments for human comfort

Despite a growing interest in multi-domain studies, we still do not have an agreed-upon conceptual framework and a systematic methodology for a mature and holistic science of human-centric indoor environments. Common design guidelines and a shared terminology for innovative test rooms and experimental procedures would allow establishing a shared understanding of the driving phenomena and the inclusion of the non-physical (psychological and contextual factors) dimensions. This can be further supported by the deployment of low-invasive physiological sensing techniques. A better understanding of the visual, IAQ and acoustic factors and their mutual influence on human comfort and occupants' perception requires further investigation. Future trends in test room experiments (and thus facility design) must account for a multi-domain and multi-disciplinary approach.

On a geographical and demographic basis, despite the increased interest in human comfort and the large availability of test room setups, these facilities are limited to specific climatic regions, while concerning tested subjects' composition, these are mainly students and faculty members. These sociological and geographical weak points may cause a non-negligible bias in the interpretations of experimental results and knowledge generation. We see the need for dedicated studies in those climatic and demographic contexts where experimental data are still not available to increase diversity and cross-validation.

In terms of test room design: test rooms mostly emulate office spaces with a limited number of occupants. Therefore, another research gap to close is the analysis of other settings and contexts, such as realistic open-plan offices and different building typologies (educational, residential, hospitals, etc.). This factor may affect the quality of the collected data and limit the research findings to office-only investigations (difficult to replicate and extend).

Concerning experiments, increased attention is being paid to occupants, also driven by the recent trends toward human-centric building design and operation. This is also reflected in the fast growth of multi-domain studies in the last decade, where the focus is the whole comfort perception analysis. Additionally, even technology-oriented studies are focused on human applications. About 40% of the technology-oriented studies aimed at developing and testing wearable systems for improved personal comfort, such as smart clothing and sensing techniques. This observation shows the necessity for a more systematic collaborative research framework whereby the environmental comfort is not handled exclusively by building physicists or engineers and architects. The topic requires a significant and proactive interaction with researchers in human factors, human-machine interaction, big data analytics, and social science, as we see more studies are focusing on psycho-physiological factors alongside IEQ and human-centric approaches.

From the operation perspective, the economic analysis showed the necessity for a better common understanding of the economic model behind test room design and construction. This may be helpful to foster local and global collaboration and connection to industry, taking advantage of the unique resources that each location provides. For this purpose, a higher transparency of existing business/economic models is recommended. Private-public partnerships may also be established with shared economic models allowing both researchers and industry partners to use these facilities to conduct controlled experimental studies, e. g., for technology development. Such models can also help sustain and expand the test rooms' role in underlining the importance of whole comfort experiments. Toward this end, funding agencies/industry partners should be informed and engaged in providing funding support to maintain/sustain and expand existing testbeds dedicated to a better understanding of human comfort in buildings.

In this context, standardization in the design and experimental

validation procedures is still missing, with the consequent limitations in error and uncertainty analysis, quality control and replicability potential. Therefore, the creation of a unified framework for keeping track of the functionality of the test room facilities is expected to establish a common ground for collaboration and cross-validation and would help to identify cultural and geographical differences and biases.

This cannot be done without a joint effort in terms of open-source research in and for society, where the resources of test room facilities and collected data are freely available for fostering the impact of these multi-domain and multi-disciplinary investigations. In this scenario, future efforts by the authors and their institutions would support research via a systematic data sharing process and a publicly available and continuously updated test room portfolio. Finally, a first Round-Robin test in test room facilities worldwide is expected to emerge as a follow up to this review.

## Declaration of competing interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

## Acknowledgments

This review was conducted within the framework of IEA-EBC Annex 79. A.L. Pisello and I. Pigliautile thank the Italian Ministry of Research for supporting [NEXT.COM](#) (Towards the NEXT generation of multi-physics and multidomain environmental COMfort) project (Prin 2017–20172F5CH4). I. Pigliautile's acknowledgments are due to the European Union's Horizon 2020 program – GEOFIT project (G.A. 792210). M. Vellei's work is supported by the French National Research Agency under the project ANR CLEF (ANR-17-CE22-0005-01). B. Dong, M. Kong and Y.P. Liu's work is supported by U.S. National Science Foundation (Award: #1949372) and Syracuse Centre of Excellence Faculty Fellowship Award. M. Favero and A. Nocente would like to thank the Research Centre on Zero Emission Neighborhoods in Smart Cities (FME ZEN, Grant n. 257660) and the Research Council of Norway (Norges Forskningsrådet) for the support. M. Schweiker is supported by a research grant (21055) from VILLUM FONDEN. Z. Deme Bélafi has been supported by the NRDI Fund (TKP2020 IES, Grant No. BME-IE-MISC) based on the charter of bolster issued by the NRDI Office under the auspices of the Ministry for Innovation and Technology within the framework of project (no. K 128199) with the support provided from the National Research, Development and Innovation Fund of Hungary, financed under the K\_18 funding scheme. A. Wagner's related work is funded by the German Ministry for Economic Affairs and Energy through various projects.

## References

- [1] Klepeis NE, Nelson WC, Ott WR, Robinson JP, Tsang AM, Switzer P, et al. The National Human Activity Pattern Survey (NHAPS): a resource for assessing exposure to environmental pollutants. *J Expo Anal Environ Epidemiol* 2001;11: 231–52. <https://doi.org/10.1038/sj.jea.7500165>.
- [2] Kjellstrom T, Holmer I, Lemke B. Workplace heat stress, health and productivity – an increasing challenge for low and middle-income countries during climate change. *Glob Health Action* 2009;2:2047. <https://doi.org/10.3402/gha.v2i0.2047>.
- [3] Tanabe SI, Iwahashi Y, Tsumura S, Nishihara N. Thermal comfort and productivity in offices under mandatory electricity savings after the Great East Japan earthquake. *Architect Sci Rev* 2013;56:4–13. <https://doi.org/10.1080/00038628.2012.744296>. Taylor & Francis.
- [4] Delzendeh E, Wu S, Lee A, Zhou Y. The impact of occupants' behaviours on building energy analysis: a research review. *Renew Sustain Energy Rev* 2017;80: 1061–71. <https://doi.org/10.1016/j.rser.2017.05.264>.
- [5] Naylor S, Gillott M, Lau T. A review of occupant-centric building control strategies to reduce building energy use. *Renew Sustain Energy Rev* 2018;96: 1–10. <https://doi.org/10.1016/j.rser.2018.07.019>.
- [6] Yan D, O'Brien W, Hong T, Feng X, Burak Gunay H, Tahmasebi F, et al. Occupant behavior modeling for building performance simulation: current state and future



- challenges. *Energy Build* 2015;107:264–78. <https://doi.org/10.1016/j.enbuild.2015.08.032>.
- [7] Lassen N, Goia F, Schiavon S, Pantelic J. Field investigations of a smiley-face polling station for recording occupant satisfaction with indoor climate. *Build Environ* 2020;185:107266. <https://doi.org/10.1016/j.buildenv.2020.107266>.
- [8] Castaldo VL, Pigliautile I, Rosso F, Cotana F, De Giorgio F, Pisello AL. How subjective and non-physical parameters affect occupants' environmental comfort perception. *Energy Build* 2018;178:107–29. <https://doi.org/10.1016/j.enbuild.2018.08.020>.
- [9] Lai ACK, Mui KW, Wong LT, Law LY. An evaluation model for indoor environmental quality (IEQ) acceptance in residential buildings. *Energy Build* 2009;41:930–6. <https://doi.org/10.1016/j.enbuild.2009.03.016>.
- [10] Palacios Temprano J, Eichholtz P, Willeboordse M, Kok N. Indoor environmental quality and learning outcomes: protocol on large-scale sensor deployment in schools. *BMJ Open* 2020;10:31233. <https://doi.org/10.1136/bmjopen-2019-031233>.
- [11] Han J, Kwon S bark, Chun C. Indoor environment and passengers' comfort in subway stations in Seoul. *Build Environ* 2016;104:221–31. <https://doi.org/10.1016/j.buildenv.2016.05.008>.
- [12] Sakellaris I, Saraga D, Mandin C, Roda C, Fossati S, de Kluizenaar Y, et al. Perceived indoor environment and occupants' comfort in European "modern" office buildings: the OFFICAIR study. *Int J Environ Res Publ Health* 2016;13:444. <https://doi.org/10.3390/ijerph13050444>.
- [13] Roulet CA, Johnner N, Foradini F, Bluyssen P, Cox C, De Oliveira Fernandes E, et al. Perceived health and comfort in relation to energy use and building characteristics. *Build Res Inf* 2006;34:467–74. <https://doi.org/10.1080/09613210600822279>.
- [14] Debnath KB, Jenkins DP, Patidar S, Peacock AD. Understanding residential occupant cooling behaviour through electricity consumption in warm-humid climate. *Buildings* 2020;10:78. <https://doi.org/10.3390/BUILDINGS10040078>.
- [15] Földváry Lčina V, Cheung T, Zhang H, de Dear R, Parkinson T, Arens E, et al. Development of the ASHRAE global thermal comfort database II. *Build Environ* 2018;142:502–12. <https://doi.org/10.1016/j.buildenv.2018.06.022>.
- [16] Franke M, Nadler C. Towards a holistic approach for assessing the impact of IEQ on satisfaction, health, and productivity. *Build Res Inf* 2020;1–28. <https://doi.org/10.1080/09613218.2020.1788917>.
- [17] Piselli C, Pisello AL. Occupant behavior long-term continuous monitoring integrated to prediction models: impact on office building energy performance. *Energy* 2019;176:667–81. <https://doi.org/10.1016/j.energy.2019.04.005>.
- [18] Torresin S, Pernigotto G, Cappelletti F, Gasparella A. Combined effects of environmental factors on human perception and objective performance: a review of experimental laboratory works. *Indoor Air* 2018;28:525–38. <https://doi.org/10.1111/ina.12457>.
- [19] Wang D, Zhang H, Arens E, Huizenga C. Observations of upper-extremity skin temperature and corresponding overall-body thermal sensations and comfort. *Build Environ* 2007;42:3933–43. <https://doi.org/10.1016/j.buildenv.2006.06.035>.
- [20] Ai Z, Hashimoto K, Melikov AK. Influence of pulmonary ventilation rate and breathing cycle period on the risk of cross-infection. *Indoor Air* 2019;29: 993–1004. <https://doi.org/10.1111/ina.12589>.
- [21] Kim W, Han H, Kim JT. The position index of a glare source at the borderline between comfort and discomfort (BCD) in the whole visual field. *Build Environ* 2009;44:1017–23. <https://doi.org/10.1016/j.buildenv.2008.07.007>.
- [22] Tuaycharoen N. Windows are less glaring when there is a preferred view. *Built-Environment Sri Lanka* 2011;9:45. <https://doi.org/10.4038/besl.v9i1-2.3064>.
- [24] Van Den Wymelenberg KG. Visual comfort, discomfort glare, and occupant fenestration control: developing a research agenda. *LEUKOS - J Illum Eng Soc North Am* 2014;10:207–21. <https://doi.org/10.1080/15502724.2014.939004>.
- [25] Pierson C, Wienold J, Bodart M. Review of factors influencing discomfort glare perception from daylight. *LEUKOS - J Illum Eng Soc North Am* 2018;14:111–48. <https://doi.org/10.1080/15502724.2018.1428617>.
- [26] Galasiu AD, Veitch JA. Occupant preferences and satisfaction with the luminous environment and control systems in daylight offices: a literature review. *Energy Build* 2006;38:728–42. <https://doi.org/10.1016/j.enbuild.2006.03.001>.
- [27] Shafavi NS, Zomorodian ZS, Tahsildoust M, Javadi M. Occupants visual comfort assessments: a review of field studies and lab experiments. *Sol Energy* 2020;208: 249–74. <https://doi.org/10.1016/j.solener.2020.07.058>.
- [28] Djongyang N, Tchinda R, Njomo D. Thermal comfort: a review paper. *Renew Sustain Energy Rev* 2010;14:2626–40. <https://doi.org/10.1016/j.rser.2010.07.040>.
- [29] Van Craenendonck S, Lauriks L, Vuye C, Kampen J. A review of human thermal comfort experiments in controlled and semi-controlled environments. *Renew Sustain Energy Rev* 2018;82:3365–78. <https://doi.org/10.1016/j.rser.2017.09.053>.
- [30] Rupp RF, Vásquez NG, Lamberts R. A review of human thermal comfort in the built environment. *Energy Build* 2015;105:178–205. <https://doi.org/10.1016/j.enbuild.2015.07.047>.
- [31] Park JY, Nagy Z. Comprehensive analysis of the relationship between thermal comfort and building control research - a data-driven literature review. *Renew Sustain Energy Rev* 2018;82:2664–79. <https://doi.org/10.1016/j.rser.2017.09.102>.
- [32] Schweiker M, Ampatzi E, Andargie MS, Andersen RK, Azar E, Barthelmes VM, et al. Review of multi-domain approaches to indoor environmental perception and behaviour. *Build Environ* 2020;176:106804. <https://doi.org/10.1016/j.buildenv.2020.106804>.
- [33] Peel MC, Finlayson BL, McMahon TA. Updated world map of the Köppen-Geiger climate classification. *Hydrol Earth Syst Sci Discuss* 2007;4:439–73.
- [34] Fisekis K, Davies M, Kolokotroni M, Langford P. Prediction of discomfort glare from windows. *Light Res Technol* 2003;35:360–9. <https://doi.org/10.1191/1365782803li0950a>.
- [35] Wienold J, Christoffersen J. Evaluation methods and development of a new glare prediction model for daylight environments with the use of CCD cameras. *Energy Build* 2006;38:743–57. <https://doi.org/10.1016/j.enbuild.2006.03.017>.
- [36] Schweiker M, Brasche S, Hawighorst M, Bischof W, Wagner A. Presenting LOBSTER, an innovative climate chamber, and the analysis of the effect of a ceiling fan on the thermal sensation and performance under summer conditions in an office-like setting. In: *Proc. - wind. Conf. 2014 count. Cost conf. A chang. World, NCEUB* 2014; 2019. p. 924–37.
- [37] Rodriguez R, Pattini A. Tolerance of discomfort glare from a large area source for work on a visual display. *Light Res Technol* 2014;46:157–70. <https://doi.org/10.1177/1477153512470386>.
- [38] Irshad K, Habib K, Basrawi F, Thirumalaiswamy N, Saidur R, Saha BB. Thermal comfort study of a building equipped with thermoelectric air duct system for tropical climate. *Appl Therm Eng* 2015;91:1141–55. <https://doi.org/10.1016/j.applthermaleng.2015.08.077>.
- [39] Karlens L, Heiselberg P, Bryn I. Occupant satisfaction with two blind control strategies: slats closed and slats in cut-off position. *Sol Energy* 2015;115:166–79. <https://doi.org/10.1016/j.solener.2015.02.031>.
- [40] Konstantzos I, Chan YC, Seibold JC, Tzempelikos A, Proctor RW, Protzman JB. View clarity index: a new metric to evaluate clarity of view through window shades. *Build Environ* 2015;90:206–14. <https://doi.org/10.1016/j.buildenv.2015.04.005>.
- [41] Ascione F, De Masi RF, De Rossi F, Ruggiero S, Vanoli GP. MATRIX, a multi activity test-room for evaluating the energy performances of "building/HVAC" systems in Mediterranean climate: experimental set-up and CFD/BPS numerical modeling. *Energy Build* 2016;126:424–46. <https://doi.org/10.1016/j.enbuild.2016.05.044>.
- [42] Kent MG, Altomonte S, Wilson R, Tregenza PR. Temporal effects on glare response from daylight. *Build Environ* 2017;113:49–64. <https://doi.org/10.1016/j.buildenv.2016.09.002>.
- [43] Luna-Navarro A, Meizoso M, DeBleecker H, Verhoeven Y, Donato M, Overend M. Facade impulse: experimental methods for stretching the envelope beyond human comfort. *Proceeding VIII Int. Congr. Archit. Envel.* 2018:21–2.
- [44] Chinazzo G, Wienold J, Andersen M. Combined effects of daylight transmitted through coloured glazing and indoor temperature on thermal responses and overall comfort. *Build Environ* 2018;144:583–97. <https://doi.org/10.1016/j.buildenv.2018.08.045>.
- [45] Lolli N, Nocente A, Brozovsky J, Woods R, Grynning S. Automatic vs manual control strategy for window blinds and ceiling lights: consequences to perceived visual and thermal discomfort. *J Daylighting* 2019;6:112–23. <https://doi.org/10.15627/jd.2019.11>.
- [46] Salamone F, Bellazzi A, Belussi L, Damato G, Danza L, Dell'acqua F, et al. Evaluation of the visual stimuli on personal thermal comfort perception in real and virtual environments using machine learning approaches. *Sensors* 2020;20. <https://doi.org/10.3390/s20061627>.
- [47] Pigliautile I, Casaccia S, Morresi N, Arnesano M, Pisello AL, Revel GM. Assessing occupants' personal attributes in relation to human perception of environmental comfort: measurement procedure and data analysis. *Build Environ* 2020;177: 106901. <https://doi.org/10.1016/j.buildenv.2020.106901>.
- [48] Zhai Y, Miao F, Yang L, Zhao S, Zhang H, Arens E. Using personally controlled air movement to improve comfort after simulated summer commute. *Build Environ* 2019;165:106329. <https://doi.org/10.1016/j.buildenv.2019.106329>.
- [49] Stacy RW, Seal E, Green J, House D. Pulmonary function in normal humans with exercise and temperature-humidity stress. *J Appl Physiol Respir Environ Exerc Physiol* 1982;53:1015–8. <https://doi.org/10.1152/jappl.1982.53.4.1015>.
- [50] Cortili G, Mognoni P, Saibene F. Work tolerance and physiological responses to thermal environment wearing protective nbc clothing. *Ergonomics* 1996;39: 620–33. <https://doi.org/10.1080/00140139608964485>.
- [51] Nishihara N, Tanabe S-I, Hayama H, Komatsu M. A cooling vest for working comfortably in a moderately hot environment, vol. 21; 2002.
- [52] Potkanowicz ES, Caine N, Otterstetter R, Glickman EL. Thermal sensation of old vs young males at 12, 18, and 27°C for 120 min. *Elsevier Ergon B Ser* 2005;3: 147–50. [https://doi.org/10.1016/S1572-347X\(05\)80025-4](https://doi.org/10.1016/S1572-347X(05)80025-4).
- [53] Laing RM, Sims ST, Wilson CA, Niven BE, Cruthers NM. Differences in wearer response to garments for outdoor activity. *Ergonomics* 2008;51:492–510. <https://doi.org/10.1080/00140130701636520>.
- [54] WH Y, ZW Y. Study on improving the thermal-wet comfort of clothing during exercise with an assembly of fabrics, vol. 17; 2009.
- [55] Waterhouse J, Hudson P, Edwards B. Effects of music tempo upon submaximal cycling performance. *Scand J Med Sci Sports* 2010;20:662–9. <https://doi.org/10.1111/j.1600-0838.2009.00948.x>.
- [56] Karlsson ICM, Rosenblad EFS. Evaluating functional clothing in climatic chamber tests versus field tests: a comparison of quantitative and qualitative methods in product development. *Ergonomics* 1998;41:1399–420. <https://doi.org/10.1080/001401398186171>.
- [57] Zhang XH, Li J, Wang Y. Effects of clothing ventilation openings on thermoregulatory responses during exercise, vol. 37; 2012.
- [58] Kim J, Na Y. Skin temperature and predicted discomfort of women wearing sheer empire style dress. *Fibers Polym* 2016;17:963–70. <https://doi.org/10.1007/s12221-016-5911-3>.



- [59] Wang H, Hu S. Experimental study on thermal sensation of people in moderate activities. *Build Environ* 2016;100:127–34. <https://doi.org/10.1016/j.buildenv.2016.02.016>.
- [60] Mekjavic IB, Ciuha U, Grönkvist M, Eiken O. The effect of low ambient relative humidity on physical performance and perceptual responses during load carriage. *Front Physiol* 2017;8:451. <https://doi.org/10.3389/fphys.2017.00451>.
- [61] Yi W, Chan APC, Wong FKW, Wong DP. Effectiveness of a newly designed construction uniform for heat strain attenuation in a hot and humid environment. *Appl Ergon* 2017;58:555–65. <https://doi.org/10.1016/j.apergo.2016.04.011>.
- [62] Ji W, Luo M, Cao B, Zhu Y, Geng Y, Lin B. A new method to study human metabolic rate changes and thermal comfort in physical exercise by CO<sub>2</sub> measurement in an airtight chamber. *Energy Build* 2018;177:402–12. <https://doi.org/10.1016/j.enbuild.2018.08.018>.
- [63] Celcar D. Thermo-physiological comfort of business clothing incorporating phase change materials in a cold environment. *Int J Cloth Sci Technol* 2018;30:49–61. <https://doi.org/10.1108/IJCS-04-2017-0050>.
- [64] Na HS, Choi JH, Kim HS, Kim T. Development of a human metabolic rate prediction model based on the use of Kinect-camera generated visual data-driven approaches. *Build Environ* 2019;160:106216. <https://doi.org/10.1016/j.buildenv.2019.106216>.
- [65] Wyon DP, Andersen I, Lundqvist GR. Spontaneous magnitude estimation of thermal discomfort during changes in the ambient temperature. *J Hyg* 1972;70:203–21. <https://doi.org/10.1017/S002217240002269>.
- [66] Ngai P, Boyce P. The effect of overhead glare on visual discomfort. *J Illum Eng Soc* 2000;29:29–38. <https://doi.org/10.1080/00994480.2000.10748315>.
- [67] Fong ML, Lin Z, Fong KF, Chow TT, Yao T. Evaluation of thermal comfort conditions in a classroom with three ventilation methods. *Indoor Air* 2011;21:231–9. <https://doi.org/10.1111/j.1600-0668.2010.00693.x>.
- [68] Cai H, Chung T. Evaluating discomfort glare from non-uniform electric light sources. *Light Res Technol* 2013;45:267–94. <https://doi.org/10.1177/1477153512453274>.
- [69] Bluyssen PM, Zhang D, Kim DH, Eijkelenboom AM, Ortiz-Sanchez M. First SenseLab studies with primary school children: exposure to different environmental configurations in the experience room. *Intell Build Int* 2019;1–18. <https://doi.org/10.1080/17508975.2019.1661220>.
- [70] Ohnaka T, Hodder S, Parsons K. The effects of simulated solar radiation to the head and trunk on the thermal comfort of seated subjects. *Elsevier Ergon B Ser* 2005;3:305–11. [https://doi.org/10.1016/S1572-347X\(05\)80049-7](https://doi.org/10.1016/S1572-347X(05)80049-7).
- [71] Strøm-Tejsten P, Wyon DP, Lagercrantz L, Fang L. Passenger evaluation of the optimum balance between fresh air supply and humidity from 7-h exposures in a simulated aircraft cabin. *Indoor Air* 2007;17:92–108. <https://doi.org/10.1111/j.1600-0668.2006.00458.x>.
- [72] Grün G, Trimmel M, Holm A. Low humidity in the aircraft cabin environment and its impact on well-being - results from a laboratory study. *Build Environ* 2012;47:23–31. <https://doi.org/10.1016/j.buildenv.2011.05.004>.
- [73] Shin HY, Kim G, Kim JT. Effect of occupants' behaviour of daylight controls on residential visual environment. *Indoor Built Environ* 2013;22:191–202. <https://doi.org/10.1177/1420326X12469735>.
- [74] International Organization for Standardization. ISO 7730:2005 - ergonomics of the thermal environment – analytical determination and interpretation of thermal comfort using calculation of the PMV and PPD indices and local thermal comfort criteria 2005.
- [75] EN 12931. Chemicals used for treatment of water intended for human consumption - chemicals for emergency use - sodium dichloroisocyanurate, anhydrous n.d. 2015.
- [76] EN 16798-1:2019 - energy performance of buildings - ventilation for buildings - Part 1: indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics - module M1-6 n.d.
- [77] EN 12464-1. Light and lighting - lighting of work places - Part 1: indoor work places n.d. 2011.
- [78] Wu Y, Liu H, Li B, Kosonen R, Kong D, Zhou S, et al. Thermal adaptation of the elderly during summer in a hot humid area: psychological, behavioral, and physiological responses. *Energy Build* 2019;203:109450. <https://doi.org/10.1016/j.enbuild.2019.109450>.
- [79] Kong D, Liu H, Wu Y, Li B, Wei S, Yuan M. Effects of indoor humidity on building occupants' thermal comfort and evidence in terms of climate adaptation. *Build Environ* 2019;155:298–307. <https://doi.org/10.1016/j.buildenv.2019.02.039>.
- [80] Schweiker M, Schakib-Ekbatan K, Fuchs X, Becker S. A seasonal approach to alliesthesia. Is there a conflict with thermal adaptation? *Energy Build* 2020;212:109745. <https://doi.org/10.1016/j.enbuild.2019.109745>.
- [81] Luo M, Cao B, Ouyang Q, Zhu Y. Indoor human thermal adaptation: dynamic processes and weighting factors. *Indoor Air* 2017;27:273–81. <https://doi.org/10.1111/ina.12323>.
- [82] Chun C, Kwok A, Mitamura T, Miwa N, Tamura A. Thermal diary: connecting temperature history to indoor comfort. *Build Environ* 2008;43:877–85. <https://doi.org/10.1016/j.buildenv.2007.01.031>.
- [83] Wu Y, Yuan M, Li C, Cheng Y, Liu H. The effect of indoor thermal history on human thermal responses in cold environments of early winter. *J Therm Biol* 2019;86:102448. <https://doi.org/10.1016/j.jtherbio.2019.102448>.
- [84] Chong D, Zhu N, Luo W, Zhang Z. Broadening human thermal comfort range based on short-term heat acclimation. *Energy* 2019;176:418–28. <https://doi.org/10.1016/j.energy.2019.04.007>.
- [85] Zhang Y, Chen H, Wang J, Meng Q. Thermal comfort of people in the hot and humid area of China—impacts of season, climate, and thermal history. *Indoor Air* 2016;26:820–30. <https://doi.org/10.1111/ina.12256>.
- [86] Cândido C, de Dear R, Ohba M. Effects of artificially induced heat acclimatization on subjects' thermal and air movement preferences. *Build Environ* 2012;49:251–8. <https://doi.org/10.1016/j.buildenv.2011.09.032>.
- [87] Du C, Li B, Liu H, Wei Y, Tan M. Quantifying the cooling efficiency of air velocity by heat loss from skin surface in warm and hot environments. *Build Environ* 2018;136:146–55. <https://doi.org/10.1016/j.buildenv.2018.03.023>.
- [88] Chow TT, Fong KF, Givoni B, Lin Z, Chan ALS. Thermal sensation of Hong Kong people with increased air speed, temperature and humidity in air-conditioned environment. *Build Environ* 2010;45:2177–83. <https://doi.org/10.1016/j.buildenv.2010.03.016>.
- [89] Luo M, Yu J, Ouyang Q, Cao B, Zhu Y. Application of dynamic airflows in buildings and its effects on perceived thermal comfort. *Indoor Built Environ* 2018;27:1162–74. <https://doi.org/10.1177/1420326X17702520>.
- [90] Cui W, Cao G, Ouyang Q, Zhu Y. Influence of dynamic environment with different airflows on human performance. *Build Environ* 2013;62:124–32. <https://doi.org/10.1016/j.buildenv.2013.01.008>.
- [91] Li C, Liu H, Li B, Cheng Y, Du C, Sheng A. Human responses to the air relative humidity ramps: a chamber study. *Build Environ* 2017;123:458–68. <https://doi.org/10.1016/j.buildenv.2017.07.024>.
- [92] Li C, Liu H, Li B, Sheng A. Seasonal effect of humidity on human comfort in a hot summer/cold winter zone in China. *Indoor Built Environ* 2019;28:264–77. <https://doi.org/10.1177/1420326X17751594>.
- [93] Du X, Li B, Liu H, Yang D, Yu W, Liao J, et al. The response of human thermal sensation and its prediction to temperature step-change (Cool-Neutral-Cool). *PloS One* 2014;9:e104320. <https://doi.org/10.1371/journal.pone.0104320>.
- [94] Li B, Du C, Tan M, Liu H, Essah E, Yao R. A modified method of evaluating the impact of air humidity on human acceptable air temperatures in hot-humid environments. *Energy Build* 2018;158:393–405. <https://doi.org/10.1016/j.enbuild.2017.09.062>.
- [95] Lan L, Lian Z, Liu W, Liu Y. Investigation of gender difference in thermal comfort for Chinese people. *Eur J Appl Physiol* 2008;102:471–80. <https://doi.org/10.1007/s00421-007-0609-2>.
- [96] Hashiguchi N, Feng Y, Tochihara Y. Gender differences in thermal comfort and mental performance at different vertical air temperatures. *Eur J Appl Physiol* 2010;109:41–8. <https://doi.org/10.1007/s00421-009-1158-7>. Springer.
- [97] Irshad K, Algarni S, Jamil B, Ahmad MT, Khan MA. Effect of gender difference on sleeping comfort and building energy utilization: field study on test chamber with thermoelectric air-cooling system. *Build Environ* 2019;152:214–27. <https://doi.org/10.1016/j.buildenv.2019.01.058>.
- [98] Wenger S, Wright T, Bechtold T, Nachbauer W. Sex-related differences in clothing-microclimate and subjective perceptions while wearing two outdoor jackets during submaximal exercise in a cool environment. *J Text Inst* 2019;110:1343–51. <https://doi.org/10.1080/00405000.2019.1580474>.
- [99] Soebarto V, Zhang H, Schiavon S. A thermal comfort environmental chamber study of older and younger people. *Build Environ* 2019;155:1–14. <https://doi.org/10.1016/j.buildenv.2019.03.032>.
- [100] Xiong J, Ma T, Lian Z, de Dear R. Perceptual and physiological responses of elderly subjects to moderate temperatures. *Build Environ* 2019;156:117–22. <https://doi.org/10.1016/j.buildenv.2019.04.012>.
- [101] Bae C, Lee H, Chun C. Predicting indoor thermal sensation for the elderly in welfare centres in Korea using local skin temperatures. *Indoor Built Environ* 2017;26:1155–67. <https://doi.org/10.1177/1420326X16664563>.
- [102] Taylor NAS, Allsopp NK, Parkes DG. Preferred room temperature of young vs aged males: the influence of thermal sensation, thermal comfort, and affect. *Journals Gerontol - Ser A Biol Sci Med Sci* 1995;50:M216–21. <https://doi.org/10.1093/gerona/50A.4.M216>.
- [103] Jin Q, Duanmu L, Zhang H, Li X, Xu H. Thermal sensations of the whole body and head under local cooling and heating conditions during step-changes between workstation and ambient environment. *Build Environ* 2011;46:2342–50. <https://doi.org/10.1016/j.buildenv.2011.05.017>.
- [104] Zhang Z, Zhang Y, Ding E. Acceptable temperature steps for transitional spaces in the hot-humid area of China. *Build Environ* 2017;121:190–9. <https://doi.org/10.1016/j.buildenv.2017.05.026>.
- [105] Chen CP, Hwang RL, Chang SY, Lu YT. Effects of temperature steps on human skin physiology and thermal sensation response. *Build Environ* 2011;46:2387–97. <https://doi.org/10.1016/j.buildenv.2011.05.021>.
- [106] Xiong J, Lian Z, Zhou X, You J, Lin Y. Effects of temperature steps on human health and thermal comfort. *Build Environ* 2015;94:144–54. <https://doi.org/10.1016/j.buildenv.2015.07.032>.
- [107] Dear RJ, Ring JW, Fanger PO. Thermal sensations resulting from sudden ambient temperature changes. *Indoor Air* 1993;3:181–92. <https://doi.org/10.1111/j.1600-0668.1993.t01-1-00004.x>.
- [108] Luo M, Cao B, Ji W, Ouyang Q, Lin B, Zhu Y. The underlying linkage between personal control and thermal comfort: psychological or physical effects? *Energy Build* 2016;111:56–63. <https://doi.org/10.1016/j.enbuild.2015.11.004>.
- [109] Kim M, Chong SC, Chun C, Choi Y. Effect of thermal sensation on emotional responses as measured through brain waves. *Build Environ* 2017;118:32–9. <https://doi.org/10.1016/j.buildenv.2017.03.023>.
- [110] Wang H, Liu L. Experimental investigation about effect of emotion state on people's thermal comfort. *Energy Build* 2020;211:109789. <https://doi.org/10.1016/j.enbuild.2020.109789>.
- [111] Wang Z, Warren K, Luo M, He X, Zhang H, Arens E, et al. Evaluating the comfort of thermally dynamic wearable devices. *Build Environ* 2020;167:106443. <https://doi.org/10.1016/j.buildenv.2019.106443>.

- [112] Gao C, Kuklane K, Wang F, Holmér I. Personal cooling with phase change materials to improve thermal comfort from a heat wave perspective. *Indoor Air* 2012;22:523–30. <https://doi.org/10.1111/j.1600-0668.2012.00778.x>.
- [113] Jovanović DB, Karkalić A RM, Tomić LD, Velićković B ZS, Radaković SS. EFFICACY OF A NOVEL PHASE CHANGE MATERIAL FOR MICROCLIMATE BODY COOLING n.d. <https://doi.org/10.2298/TSCI130216129J>.
- [114] Luo M, Arens E, Zhang H, Ghahramani A, Wang Z. Thermal comfort evaluated for combinations of energy-efficient personal heating and cooling devices. *Build Environ* 2018;143:206–16. <https://doi.org/10.1016/j.buildenv.2018.07.008>.
- [115] Pasut W, Zhang H, Arens E, Kaam S, Zhai Y. Effect of a heated and cooled office chair on thermal comfort. *HVAC R Res* 2013;19:574–83. <https://doi.org/10.1080/10789669.2013.781371>.
- [116] Zhang YF, Wyon DP, Fang L, Melikov AK. The influence of heated or cooled seats on the acceptable ambient temperature range. *Ergonomics* 2007;50:586–600. <https://doi.org/10.1080/00140130601154921>.
- [117] Du C, Liu H, Li C, Xiong J, Li B, Li G, et al. Demand and efficiency evaluations of local convective heating to human feet and low body parts in cold environments. *Build Environ* 2020;171:106662. <https://doi.org/10.1016/j.buildenv.2020.106662>.
- [118] Oi H, Yanagi K, Tabat K, Tochihar Y. Effects of heated seat and foot heater on thermal comfort and heater energy consumption in vehicle. *Ergonomics* 2011;54:690–9. <https://doi.org/10.1080/001401309.2011.595513>.
- [119] Wang Y, Hwang RL, Lian Z. A study on the parameter ranges of the locally supplied air in a task ambient conditioning system with chest exposure. *Sci Technol Built Environ* 2018;24:238–47. <https://doi.org/10.1080/23744731.2017.1373701>.
- [120] Brooks JE, Parsons KC. An ergonomics investigation into human thermal comfort using an automobile seat heated with encapsulated carbonized fabric (ECF). *Ergonomics* 1999;42:661–73. <https://doi.org/10.1080/001401399185379>.
- [121] Irshad K, Habib K, Kareem MW, Basrawi F, Saha BB. Evaluation of thermal comfort in a test room equipped with a photovoltaic assisted thermo-electric air duct cooling system. *Int J Hydrogen Energy* 2017;42:26956–72. <https://doi.org/10.1016/j.ijhydene.2017.05.247>.
- [122] Schiavon S, Rim D, Pasut W, Nazaroff WW. Sensation of draft at uncovered ankles for women exposed to displacement ventilation and underfloor air distribution systems. *Build Environ* 2016;96:228–36. <https://doi.org/10.1016/j.buildenv.2015.11.009>.
- [123] Fong ML, Hanby V, Greenough R, Lin Z, Cheng Y. Acceptance of thermal conditions and energy use of three ventilation strategies with six exhaust configurations for the classroom. *Build Environ* 2015;94:606–19. <https://doi.org/10.1016/j.buildenv.2015.10.024>.
- [124] Sun W, Cheong KWD, Melikov AK. Subjective study of thermal acceptability of novel enhanced displacement ventilation system and implication of occupants' personal control. *Build Environ* 2012;57:49–57. <https://doi.org/10.1016/j.buildenv.2012.04.004>.
- [125] Kawahara Y, Emura K, Nabeshima M, Bougaki K, Kadoya M. Air-conditioning with underfloor air supply: comfort in non-uniform thermal environment. *Build Serv Eng Technol* 1999;20:1–7. <https://doi.org/10.1177/014362449902000101>.
- [126] Ali AHH, Morsy MG. Energy efficiency and indoor thermal perception: a comparative study between radiant panel and portable convective heaters. *Energy Effic* 2010;3:283–301. <https://doi.org/10.1007/s12053-010-9077-3>.
- [127] Jin Q, Simone A, Olesen BW, Holmberg SKM, Bourdakos E. Laboratory study of subjective perceptions to low temperature heating systems with exhaust ventilation in Nordic countries. *Sci Technol Built Environ* 2017;23:457–68. <https://doi.org/10.1080/23744731.2017.1251266>.
- [128] Hodder SG, Loveday DL, Parsons KC, Taki AH. Thermal comfort in chilled ceiling and displacement ventilation environments: vertical radiant temperature asymmetry effects. *Energy Build* 1998;27:167–73. [https://doi.org/10.1016/s0378-7788\(97\)00038-8](https://doi.org/10.1016/s0378-7788(97)00038-8).
- [129] Parsons K. Displacement ventilation environments with chilled ceilings: thermal comfort design within the context of the BS EN ISO7730 versus adaptive debate. *Energy Build* n.d.
- [130] Pasut W, Arens E, Zhang H, Zhai Y. Enabling energy-efficient approaches to thermal comfort using room air motion. *Build Environ* 2014;79:13–9. <https://doi.org/10.1016/j.buildenv.2014.04.024>.
- [131] Guo Y, Chan AP, Wong FK, Li Y, Sun S, Han X. Developing a hybrid cooling vest for combating heat stress in the construction industry. *Textil Res J* 2019;89:254–69. <https://doi.org/10.1177/0040517517743685>.
- [132] Chan AP, Yang Y, Guo Y, Yam MC, Song W. Evaluating the physiological and perceptual responses of wearing a newly designed construction work uniform. *Textil Res J* 2016;86:659–73. <https://doi.org/10.1177/0040517515591773>.
- [133] Pang TY, Subic A, Takla M. Evaluation of thermal and evaporative resistances in cricket helmets using a sweating manikin. *Appl Ergon* 2014;45:300–7. <https://doi.org/10.1016/j.apergo.2013.04.011>.
- [134] Brühwiler PA. Role of the visor in forced convective heat loss with bicycle helmets. *Int J Ind Ergon* 2009;39:255–9. <https://doi.org/10.1016/j.ergon.2008.08.001>.
- [135] Davis JK, Matt Laurent C, Allen KE, Zhang Y, Stolworthy NI, Welch TR, et al. Influence of clothing on thermoregulation and comfort during exercise in the heat. *J Strength Condit Res* 2017;31:3435–43. <https://doi.org/10.1519/JSC.0000000000001754>.
- [136] Branson DH, Dejonge JO, Munson D. Thermal response associated with prototype pesticide protective clothing. *Textil Res J* 1986;56:27–34. <https://doi.org/10.1177/004051758605600104>.
- [137] Hayashi C, Tokura H. Improvement of thermophysiological stress in participants wearing protective clothing for spraying pesticide, and its application in the field. *Int Arch Occup Environ Health* 2000;73:187–94. <https://doi.org/10.1007/s004200050026>.
- [138] Ma N, Lu Y, Xu F, Dai H. Development and performance assessment of electrically heated gloves with smart temperature control function. *Int J Occup Saf Ergon* 2020;26:46–54. <https://doi.org/10.1080/10803548.2018.1457886>.
- [139] Song W, Wang F, Zhang C, Lai D. On the improvement of thermal comfort of university students by using electrically and chemically heated clothing in a cold classroom environment. *Build Environ* 2015;94:704–13. <https://doi.org/10.1016/j.buildenv.2015.10.017>.
- [140] Chong D, Zhu N, Luo W, Pan X. Human thermal risk prediction in indoor hyperthermal environments based on random forest. *Sustain Cities Soc* 2019;49:101595. <https://doi.org/10.1016/j.scs.2019.101595>.
- [141] Chong D, Zhu N, Zheng G. Developing a continuous graphical index to assess heat strain in extremely hot environments. *Build Environ* 2018;138:283–92. <https://doi.org/10.1016/j.buildenv.2018.05.009>.
- [142] Lee K, Choi H, Choi JH, Kim T. Development of a data-driven predictive model of clothing thermal insulation estimation by using advanced computational approaches. *Sustainability* 2019;11:5702. <https://doi.org/10.3390/su11205702>.
- [143] Yeom D, Choi JH, Kang SH. Investigation of the physiological differences in the immersive virtual reality environment and real indoor environment: focused on skin temperature and thermal sensation. *Build Environ* 2019;154:44–54. <https://doi.org/10.1016/j.buildenv.2019.03.013>.
- [144] Ibrahim A, Ali H, Zghoul A, Jaradat S. Mood state and human evaluation of the thermal environment using virtual settings. *Indoor Built Environ* 2019. <https://doi.org/10.1177/1420326X19880325>. 1420326X19880325.
- [145] Orehouin K, Pont U, Mahdavi A. Short-term occupancy implications of digitally provided outside views in window-less rooms. In: *International conference on architecture and urban design*; 2012.
- [146] Yang H, Cao B, Zhu Y. Study on the effects of chair heating in cold indoor environments from the perspective of local thermal sensation. *Energy Build* 2018;180:16–28. <https://doi.org/10.1016/j.enbuild.2018.09.003>.
- [147] Jeon JY, Hong JY, Kim SM, Lee PJ. Classification of heavy-weight floor impact sounds in multi-dwelling houses using an equal-appearing interval scale. *Build Environ* 2015;94:821–8. <https://doi.org/10.1016/j.buildenv.2015.07.021>.
- [148] Zhang D, Tenpierik M, Bluyssen PM. Interaction effect of background sound type and sound pressure level on children of primary schools in The Netherlands. *Appl Acoust* 2019;154:161–9. <https://doi.org/10.1016/j.apacoust.2019.05.007>.
- [149] Weisser A, Buchholz JM, Keidser G. Complex acoustic environments: review, framework, and subjective model. *Trends Hear* 2019;23. <https://doi.org/10.1177/2331216519881346>. 2331216519881346.
- [150] Haka M, Haapakangas A, Keränen J, Hakala J, Keskinen E, Hongisto V. Performance effects and subjective disturbance of speech in acoustically different office types - a laboratory experiment. *Indoor Air* 2009;19:454–67. <https://doi.org/10.1111/j.1600-0668.2009.00608.x>.
- [151] Kang S, Ou D. The effects of speech intelligibility on work performance in Chinese open-plan offices: a laboratory study. *Acta Acust United with Acust* 2019;105:9–13. <https://doi.org/10.3813/AAA.919281>.
- [152] Hongisto V, Oliva D, Rekola L. Subjective and objective rating of spectrally different pseudorandom noises—implications for speech masking design. *J Acoust Soc Am* 2015;137:1344–55. <https://doi.org/10.1121/1.4913273>.
- [153] Abbasi AM, Motamedzade M, Aliafadi M, Golmohammadi R, Tapak L. Study of the physiological and mental health effects caused by exposure to low-frequency noise in a simulated control room. *Build Acoust* 2018;25:233–48. <https://doi.org/10.1177/1351010X18779518>.
- [154] Jeon JY, Ryu JK, Lee PJ. A quantification model of overall dissatisfaction with indoor noise environment in residential buildings. *Appl Acoust* 2010;71:914–21. <https://doi.org/10.1016/j.apacoust.2010.06.001>.
- [155] Yu B, Kang J, Ma H. Development of indicators for the soundscape in urban shopping streets. *Acta Acust United with Acust* 2016;102:462–73. <https://doi.org/10.3813/AAA.918965>.
- [156] Hermida L, Pavón I. Spatial aspects in urban soundscapes: binaural parameters application in the study of soundscapes from Bogotá-Colombia and Brasília-Brazil. *Appl Acoust* 2019;145:420–30. <https://doi.org/10.1016/j.apacoust.2018.10.011>.
- [157] Hong JY, Ong ZT, Lam B, Ooi K, Gan WS, Kang J, et al. Effects of adding natural sounds to urban noises on the perceived loudness of noise and soundscape quality. *Sci Total Environ* 2020;711:134571. <https://doi.org/10.1016/j.scitotenv.2019.134571>.
- [158] Ne'Eman E, Hopkinson RG. Critical minimum acceptable window size: a study of window design and provision of a view. *Light Res Technol* 1970;2:17–27. <https://doi.org/10.1177/14771535700020010701>.
- [159] Arsenault H, Hébert M, Dubois MC. Effects of glazing colour type on perception of daylight quality, arousal, and switch-on patterns of electric light in office rooms. *Build Environ* 2012;56:223–31. <https://doi.org/10.1016/j.buildenv.2012.02.032>.
- [160] Dubois M-C, Cantin F, Johnsen K. The effect of coated glazing on visual perception: a pilot study using scalemodels. *Light Res Technol* 2007;39:283–304. <https://doi.org/10.1177/1477153507080074>.
- [161] Huang W, Yang Y, Luo MR. Discomfort glare caused by white LEDs having different spectral power distributions. *Light Res Technol* 2018;50:921–36. <https://doi.org/10.1177/1477153517704996>.
- [162] Kimura-Minoda T, Ayama M. Evaluation of discomfort glare from color leds and its correlation with individual variations in brightness sensitivity. *Color Res Appl* 2011;36:286–94. <https://doi.org/10.1002/col.20630>.
- [163] Osterhaus WKE, Bailey IL. Large area glare sources and their effect on visual discomfort and visual performance at computer workstations. In: *Conf. Rec. - IAS*

- annu. Meet. (IEEE Ind. Appl. Soc., vol. 1992- janua, institute of electrical and electronics engineers inc.; 1992. p. 1825–9. <https://doi.org/10.1109/IAS.1992.244537>.
- [164] Á Logadóttir, Christoffersen J, Fotios S. Investigating the use of an adjustment task to set the preferred illuminance in a workplace environment. *Light Res Technol* 2011;43:403–22. <https://doi.org/10.1177/1477153511400971>.
- [165] Chamilothoni K, Chinazzo G, Rodrigues J, Dan-Glauser ES, Wienold J, Andersen M. Subjective and physiological responses to façade and sunlight pattern geometry in virtual reality. *Build Environ* 2019;150:144–55. <https://doi.org/10.1016/j.buildenv.2019.01.009>.
- [166] Moscoso C, Chamilothoni K, Wienold J, Andersen M, Matusiak B. Window size effects on subjective impressions of daylight spaces: indoor studies at high latitudes using virtual reality. *Leukos* 2020;1–23. <https://doi.org/10.1080/15502724.2020.1726183>.
- [167] Fotios SA. Lamp colour properties and apparent brightness: a review. *Light Res Technol* 2001;33:163–78. <https://doi.org/10.1177/136578280103300306>.
- [168] Wei M, Houser KW, Allen GR, Beers WW. Color preference under LEDs with diminished yellow emission. *LEUKOS - J Illum Eng Soc North Am* 2014;10:119–31. <https://doi.org/10.1080/15502724.2013.865212>.
- [169] Hu X, Houser KW, Tiller DK. Higher color temperature lamps may not appear brighter. *LEUKOS - J Illum Eng Soc North Am* 2006;3:69–81. <https://doi.org/10.1582/LEUKOS.2006.03.01.004>.
- [170] Royer M, Wilkerson A, Wei M, Houser K, Davis R. Human perceptions of colour rendition vary with average fidelity, average gamut, and gamut shape. *Light Res Technol* 2017;49:966–91. <https://doi.org/10.1177/1477153516663615>.
- [171] Velds M. User acceptance studies to evaluate discomfort glare in daylight rooms. *Sol Energy* 2002;73:95–103. [https://doi.org/10.1016/S0038-092X\(02\)00037-3](https://doi.org/10.1016/S0038-092X(02)00037-3).
- [172] Kent MG, Fotios S, Altomonte S. An experimental study on the effect of visual tasks on discomfort due to peripheral glare. *Leukos* 2019;15:17–28. <https://doi.org/10.1080/15502724.2018.1489282>.
- [173] Altomonte S, Kent MG, Tregenza PR, Wilson R. Visual task difficulty and temporal influences in glare response. *Build Environ* 2016;95:209–26. <https://doi.org/10.1016/j.buildenv.2015.09.021>.
- [174] Boubekri M, Boyer LL. Effect of window size and sunlight presence on glare. *Light Res Technol* 1992;24:69–74. <https://doi.org/10.1177/096032719202400203>.
- [175] Geerdinck LM, Van Gheluwe JR, Vissenberg MCJM. Discomfort glare perception of non-uniform light sources in an office setting. *J Environ Psychol* 2014;39:5–13. <https://doi.org/10.1016/j.jenvp.2014.04.002>.
- [176] Kent M, Altomonte S, Tregenza P, Wilson R. Discomfort glare and time of day. *Light Res Technol* 2015;47:641–57. <https://doi.org/10.1177/1477153514547291>.
- [177] Shin JY, Yun GY, Kim JT. View types and luminance effects on discomfort glare assessment from windows. *Energy Build* 2012;46:139–45. <https://doi.org/10.1016/j.enbuild.2011.10.036>. Elsevier.
- [178] Van Den Wymelenberg K, Inanici M, Johnson P. The effect of luminance distribution patterns on occupant preference in a daylight office environment. *LEUKOS - J Illum Eng Soc North Am* 2010;7:103–22. <https://doi.org/10.1582/LEUKOS.2010.07.02003>.
- [179] Krüger EL, Tamura C, Trento TW. Identifying relationships between daylight variables and human preferences in a climate chamber. *Sci Total Environ* 2018; 642:1292–302. <https://doi.org/10.1016/j.scitotenv.2018.06.164>.
- [180] Boyce PR, Hunter CM, Inčan C. Overhead glare and visual discomfort. *J Illum Eng Soc* 2003;32:73–88. <https://doi.org/10.1080/00994480.2003.10748406>.
- [181] Taniguchi T, Iwata T, Sato M, Honma M. Proposal OF a method for determining slat-rotation speed OF automated blinds to reduce discomfort caused BY the change IN window brightness. *J Environ Eng (Transactions ASCE)* 2017;82:551–9. <https://doi.org/10.3130/aije.82.551>.
- [182] Tuaycharoen N, Tregenza PR. View and discomfort glare from windows. *Light Res Technol* 2007;39:185–200. <https://doi.org/10.1177/1365782807077193>.
- [183] Bian Y, Ma Y. Subjective survey & simulation analysis of time-based visual comfort in daylight spaces. *Build Environ* 2018;131:63–73. <https://doi.org/10.1016/j.buildenv.2018.01.007>.
- [184] Bian Y, Luo T. Investigation of visual comfort metrics from subjective responses in China: a study in offices with daylight. *Build Environ* 2017;123:661–71. <https://doi.org/10.1016/j.buildenv.2017.07.035>.
- [185] Kim W, Kim Jeong Tai. A position index formula for evaluation of glare source in the visual field. *Indoor Built Environ* 2011;20:47–53. <https://doi.org/10.1177/1420326X10389267>.
- [186] Suk JY, Schiler M, Kensek K. Investigation of existing discomfort glare indices using human subject study data. *Build Environ* 2017;113:121–30. <https://doi.org/10.1016/j.buildenv.2016.09.018>.
- [187] Yamín Garretón JA, Rodríguez RG, Ruiz A, Pattini AE. Degree of eye opening: a new discomfort glare indicator. *Build Environ* 2015;88:142–50. <https://doi.org/10.1016/j.buildenv.2014.11.010>.
- [188] Karlén L, Heiselberg P, Bryn I, Johra H. Verification of simple illuminance based measures for indication of discomfort glare from windows. *Build Environ* 2015; 92:615–26. <https://doi.org/10.1016/j.buildenv.2015.05.040>.
- [189] Van Den Wymelenberg K, Inanici M. A critical investigation of common lighting design metrics for predicting human visual comfort in offices with daylight. *LEUKOS - J Illum Eng Soc North Am* 2014;10:145–64. <https://doi.org/10.1080/15502724.2014.881720>.
- [190] Van Den Wymelenberg K, Inanici M. Evaluating a new suite of luminance-based design metrics for predicting human visual comfort in offices with daylight. *LEUKOS - J Illum Eng Soc North Am* 2016;12:113–38. <https://doi.org/10.1080/15502724.2015.1062392>.
- [191] Bian Y, Dai Q, Ma Y, Liu L. Variable set points of glare control strategy for side-lit spaces: daylight glare tolerance by time of day. *Sol Energy* 2020;201:268–78. <https://doi.org/10.1016/j.solener.2020.03.016>.
- [192] Kim JT, Shin JY, Yun GY. Prediction of discomfort glares from windows: influence of the subjective evaluation of window views. *Indoor Built Environ* 2012;21:92–7. <https://doi.org/10.1177/1420326X11423157>.
- [193] Suk JY, Schiler M, Kensek K. Absolute glare factor and relative glare factor based metric: predicting and quantifying levels of daylight glare in office space. *Energy Build* 2016;130:8–19. <https://doi.org/10.1016/j.enbuild.2016.08.021>.
- [194] Yamín Garretón JA, Rodríguez RG, Pattini AE. Glare indicators: an analysis of ocular behaviour in an office equipped with Venetian blinds. *Indoor Built Environ* 2016;25:69–80. <https://doi.org/10.1177/1420326X14538082>.
- [195] Rodríguez R, Yamín Garretón J, Pattini AE. Glare and cognitive performance in screen work in the presence of sunlight. *Light Res Technol* 2016;48:221–38. <https://doi.org/10.1177/1477153515577851>.
- [196] Hamedani Z, Solgi E, Hine T, Skates H. Revealing the relationships between luminous environment characteristics and physiological, ocular and performance measures: an experimental study. *Build Environ* 2020;172:106702. <https://doi.org/10.1016/j.buildenv.2020.106702>.
- [197] Choi J-H. Investigation of human eye pupil sizes as a measure of visual sensation in the workplace environment with a high lighting colour temperature. *Indoor Built Environ* 2017;26:488–501. <https://doi.org/10.1177/1420326X15626585>.
- [198] Choi JH, Zhu R. Investigation of the potential use of human eye pupil sizes to estimate visual sensations in the workplace environment. *Build Environ* 2015;88: 73–81. <https://doi.org/10.1016/j.buildenv.2014.11.025>.
- [199] Sun C, Lian Z, Lan L. Work performance in relation to lighting environment in office buildings. *Indoor Built Environ* 2019;28:1064–82. <https://doi.org/10.1177/1420326X18820089>.
- [200] Smolders KCHJ, de Kort YAW. Investigating daytime effects of correlated colour temperature on experiences, performance, and arousal. *J Environ Psychol* 2017; 50:80–93. <https://doi.org/10.1016/j.jenvp.2017.02.001>.
- [201] Huiberts LM, Smolders KCHJ, de Kort YAW. Non-image forming effects of illuminance level: exploring parallel effects on physiological arousal and task performance. *Physiol Behav* 2016;164:129–39. <https://doi.org/10.1016/j.physbeh.2016.05.035>.
- [202] Huiberts LM, Smolders KCHJ, De Kort YAW. Seasonal and time-of-day variations in acute non-image forming effects of illuminance level on performance, physiology, and subjective well-being. *Chronobiol Int* 2017;34:827–44. <https://doi.org/10.1080/07420528.2017.1324471>.
- [203] de Vries A, Souman JL, de Ruyter B, Heynderickx I, de Kort YAW. Lighting up the office: the effect of wall luminance on room appraisal, office workers' performance, and subjective alertness. *Build Environ* 2018;142:534–43. <https://doi.org/10.1016/j.buildenv.2018.06.046>.
- [204] Liang R, Kent M, Wilson R, Wu Y. Development of experimental methods for quantifying the human response to chromatic glazing. *Build Environ* 2019;147: 199–210. <https://doi.org/10.1016/j.buildenv.2018.09.044>.
- [205] Newsham GR, Mancini S, Marchand RG. Detection and acceptance of demand-responsive lighting in offices with and without daylight. *LEUKOS - J Illum Eng Soc North Am* 2008;4:139–56. <https://doi.org/10.1582/LEUKOS.2007.004.03.001>.
- [206] Newsham G, Arsénault C, Veitch J, Tosco AM, Duval C. Task lighting effects on office worker satisfaction and performance, and energy efficiency. *LEUKOS - J Illum Eng Soc North Am* 2005;1:7–26. <https://doi.org/10.1582/LEUKOS.01.04.001>.
- [207] Chraïbi S, Crommentuijn L, Loenen E van, Rosemann A. Influence of wall luminance and uniformity on preferred task illuminance. *Build Environ* 2017;117: 24–35. <https://doi.org/10.1016/j.buildenv.2017.02.026>.
- [208] Loe L, Mansfield KP, Rowlands E. Appearance of lit environment and its relevance in lighting design: experimental study. *Light Res Technol* 1994;26:119–33. <https://doi.org/10.1177/096032719402600301>.
- [209] Newsham G, Veitch J. Lighting quality recommendations for VDT offices: a new method of derivation. *Light Res Technol* 2001;33:97–113. <https://doi.org/10.1177/136578280103300205>.
- [210] Ru T, de Kort YAW, Smolders KCHJ, Chen Q, Zhou G. Non-image forming effects of illuminance and correlated color temperature of office light on alertness, mood, and performance across cognitive domains. *Build Environ* 2019;149:253–63. <https://doi.org/10.1016/j.buildenv.2018.12.002>.
- [211] Smolders KCHJ, de Kort YAW, Cluitmans PJM. A higher illuminance induces alertness even during office hours: findings on subjective measures, task performance and heart rate measures. *Physiol Behav* 2012;107:7–16. <https://doi.org/10.1016/j.physbeh.2012.04.028>.
- [212] Smolders KCHJ, de Kort YAW. Bright light and mental fatigue: effects on alertness, vitality, performance and physiological arousal. *J Environ Psychol* 2014;39:77–91. <https://doi.org/10.1016/j.jenvp.2013.12.010>.
- [213] Kompier ME, Smolders KCHJ, van Marken Lichtenbelt WD, de Kort YAW. Effects of light transitions on measures of alertness, arousal and comfort. *Physiol Behav* 2020;223:112999. <https://doi.org/10.1016/j.physbeh.2020.112999>.
- [214] Hellingha H. Daylight and view - the influence of windows on the visual quality of indoor spaces [PhD thesis]. 2013. <https://doi.org/10.4233/uuid:2daeb534-9572-4c85-bf8f-308f3f6825fd>.
- [215] Shamsul BM, Sia CC, Ng Y, Karmegan K. Effects of light's colour temperatures on visual comfort level, task performances, and alertness among students. *Am J Publ Health Res* 2013;1:159–65. <https://doi.org/10.12691/ajphr-1-7-3>.
- [216] Ortiz MA, Zhang D, Bluysen PM. Table top surface appraisal by school children under different lighting conditions tested in the Senselab. *E3S Web Conf.* 2019; 111. <https://doi.org/10.1051/e3sconf/201911102040>. EDP Sciences.



- [217] Tonello G, Hernández de Borsetti N, Borsetti H, Tereschuk L, López Zigarán S. Perceived well-being and light-reactive hormones: an exploratory study. *Light Res Technol* 2019;51:184–205. <https://doi.org/10.1177/1477153517750714>.
- [218] Gou Z, Lau SS-Y, Qian F. Comparison of mood and task performance in naturally-lit and artificially-lit environments. *Indoor Built Environ* 2015;24:27–36. <https://doi.org/10.1177/1420326X13507792>.
- [219] Cajochen C, Frey S, Anders D, Späti J, Bues M, Pross A, et al. Evening exposure to a light-emitting diodes (LED)-backlit computer screen affects circadian physiology and cognitive performance. *J Appl Physiol* 2011;110:1432–8. <https://doi.org/10.1152/jappphysiol.00165.2011>.
- [220] Sarey Khanie M, Stoll J, Einhäuser W, Wienold J, Andersen M. Gaze and discomfort glare, Part 1: development of a gaze-driven photometry. *Light Res Technol* 2017;49:845–65. <https://doi.org/10.1177/1477153516649016>.
- [221] Konstantzos I, Tzempelikos A. Daylight glare evaluation with the sun in the field of view through window shades. *Build Environ* 2017;113:65–77. <https://doi.org/10.1016/j.buildenv.2016.09.009>.
- [222] Linhart F, Scartezzini JL. Evening office lighting - visual comfort vs. energy efficiency vs. performance? *Build Environ* 2011;46:981–9. <https://doi.org/10.1016/j.buildenv.2010.10.002>.
- [223] Suk JY. Luminance and vertical eye illuminance thresholds for occupants' visual comfort in daylight office environments. *Build Environ* 2019;148:107–15. <https://doi.org/10.1016/j.buildenv.2018.10.058>.
- [224] Borisuit A, Linhart F, Scartezzini J-L, Mü M. Effects of realistic office daylighting and electric lighting conditions on visual comfort, alertness and mood n.d. <https://doi.org/10.1177/1477153514531518>.
- [225] Boubekri M, Hull RB, Boyer LL. Impact of window size and sunlight penetration on office workers' mood and satisfaction. *Environ Behav* 1991;23:474–93. <https://doi.org/10.1177/0013916591234004>.
- [226] Licina D, Melikov A, Sekhar C, Tham KW. Human convective boundary layer and its interaction with room ventilation flow. *Indoor Air* 2015;25:21–35. <https://doi.org/10.1111/ina.12120>.
- [227] Licina D, Pantelic J, Melikov A, Sekhar C, Tham KW. Experimental investigation of the human convective boundary layer in a quiescent indoor environment. *Build Environ* 2014;75:79–91. <https://doi.org/10.1016/j.buildenv.2014.01.016>.
- [228] Licina D, Melikov A, Sekhar C, Tham KW. Air temperature investigation in microenvironment around a human body. *Build Environ* 2015;92:39–47. <https://doi.org/10.1016/j.buildenv.2015.04.014>.
- [229] Gunnarsen L, Ole Fanger P. Adaptation to indoor air pollution. *Environ Int* 1992;18:43–54. [https://doi.org/10.1016/0160-4120\(92\)90209-M](https://doi.org/10.1016/0160-4120(92)90209-M).
- [230] Johnsen CR, Heinig JH, Schmidt K, Albrechtsen O, Nielsen PA, Wolkoff P, et al. A study of human reactions to emissions from building materials in climate chambers. Part I: clinical data, performance and comfort. *Indoor Air* 1991;1:377–88. <https://doi.org/10.1111/j.1600-0668.1991.00002.x>.
- [231] Amano K, Takahashi H, Kato S, Tani H, Ishiguro T, Higuchi M, et al. Indoor odor exposure effects on psycho-physiological states during intellectual tasks and rest. *HVAC R Res* 2012;18:217–24. <https://doi.org/10.1080/10789669.2011.599765>.
- [232] Melikov AK, Kaczmarczyk J. Air movement and perceived air quality. *Build Environ* 2012;47:400–9. <https://doi.org/10.1016/j.buildenv.2011.06.017>.
- [233] Allen JG, MacNaughton P, Satish U, Santanam S, Vallarino J, Spengler JD. Associations of cognitive function scores with carbon dioxide, ventilation, and volatile organic compound exposures in office workers: a controlled exposure study of green and conventional office environments. *Environ Health Perspect* 2016;124:805–12. <https://doi.org/10.1289/ehp.1510037>.
- [234] Wargocki P. Perceived air quality, sick building syndrome (SBS) symptoms and productivity in an office with two different pollution loads. *Indoor Air* 1999;9:165–79. <https://doi.org/10.1111/j.1600-0668.1999.t01-1-00003.x>.
- [235] Armijos Moya T, Bluyssen PM. Appraisal and identification of different sources of smell by primary school children in the air quality test chamber of the SenseLab. *Intell Build Int* 2019;1–14. <https://doi.org/10.1080/17508975.2019.1682493>.
- [236] Molhave L, Kjaergaard SK, Attermann J. Respiratory effects of experimental exposure to office dust. *Indoor Air* 2004;14:376–84. <https://doi.org/10.1111/j.1600-0668.2004.00252.x>.
- [237] Pantelic J, Tham KW, Licina D. Effectiveness of a personalized ventilation system in reducing personal exposure against directly released simulated cough droplets. *Indoor Air* 2015;25:683–93. <https://doi.org/10.1111/ina.12187>.
- [238] Licina D, Tian Y, Nazaroff WW. Inhalation intake fraction of particulate matter from localized indoor emissions. *Build Environ* 2017;123:14–22. <https://doi.org/10.1016/j.buildenv.2017.06.037>.
- [239] Pantelic J, Liu S, Pistore L, Licina D, Vannucci M, Sadrizadeh S, et al. Personal CO<sub>2</sub> cloud: laboratory measurements of metabolic CO<sub>2</sub> inhalation zone concentration and dispersion in a typical office desk setting. *J Expo Sci Environ Epidemiol* 2020;30:328–37. <https://doi.org/10.1038/s41370-019-0179-5>.
- [240] Alotaibi S, Chakroun W, Habchi C, Ghali K, Ghaddar N. Effectiveness of contaminant confinement in office spaces equipped with ceiling personalized ventilation system. *Build Simul* 2018;11:773–86. <https://doi.org/10.1007/s12273-018-0437-9>.
- [241] Bivolarova M, Kierat W, Zavri E, Popiolek Z, Melikov A. Effect of airflow interaction in the breathing zone on exposure to bio-effluents. *Build Environ* 2017;125:216–26. <https://doi.org/10.1016/j.buildenv.2017.08.043>.
- [242] Bolashikov Z, Melikov A, Spilak M, Nastase I, Meslem A. Improved inhaled air quality at reduced ventilation rate by control of airflow interaction at the breathing zone with lobed jets. *HVAC R Res* 2014;20:238–50. <https://doi.org/10.1080/10789669.2013.864919>.
- [243] Cermak R, Melikov AK, Forejt L, Kovar O. Performance of personalized ventilation in conjunction with mixing and displacement ventilation. *HVAC R Res* 2006;12:295–311. <https://doi.org/10.1080/10789669.2006.10391180>.
- [244] Bivolarova MP, Melikov AK, Mizutani C, Kajiwara K, Bolashikov ZD. Bed-integrated local exhaust ventilation system combined with local air cleaning for improved IAQ in hospital patient rooms. *Build Environ* 2016;100:10–8. <https://doi.org/10.1016/j.buildenv.2016.02.006>.
- [245] Verhaart J, Li R, Zeiler W. User interaction patterns of a personal cooling system: a measurement study. *Sci Technol Built Environ* 2018;24:57–72. <https://doi.org/10.1080/23744731.2017.1333365>.
- [246] Assaad D Al, Ghali K, Ghaddar N, Habchi C. Mixing ventilation coupled with personalized sinusoidal ventilation: optimal frequency and flow rate for acceptable air quality. *Energy Build* 2017;154:569–80. <https://doi.org/10.1016/j.enbuild.2017.08.090>.
- [247] Melikov AK, Cermak R, Majer M. Personalized ventilation: evaluation of different air terminal devices. *Energy Build* 2002;34:829–36. [https://doi.org/10.1016/S0378-7788\(02\)00102-0](https://doi.org/10.1016/S0378-7788(02)00102-0).
- [248] Zhang H, Arens E, Kim DE, Buchberger E, Bauman F, Huizenga C. Comfort, perceived air quality, and work performance in a low-power task-ambient conditioning system. *Build Environ* 2010;45:29–39. <https://doi.org/10.1016/j.buildenv.2009.02.016>.
- [249] Li R, Sekhar SC, Melikov AK. Thermal comfort and IAQ assessment of under-floor air distribution system integrated with personalized ventilation in hot and humid climate. *Build Environ* 2010;45:1906–13. <https://doi.org/10.1016/j.buildenv.2010.03.003>.
- [250] Faulkner D, Fisk WJ, Sullivan DP, Lee SM. Ventilation efficiencies and thermal comfort results of a desk-edge-mounted task ventilation system. *Indoor Air* 2004;14:92–7. <https://doi.org/10.1111/j.1600-0668.2004.00295.x>.
- [251] Piasecki M, Kostyrko K, Fedorczak-Cisak M, Nowak K. Air enthalpy as an IAQ indicator in hot and humid environment—experimental evaluation. *Energies* 2020;13:1481. <https://doi.org/10.3390/en13061481>.
- [252] Brambilla A, Hu W, Samangouei R, Cadorin R, Davis W. How correlated colour temperature manipulates human thermal perception and comfort. *Build Environ* 2020;177:106929. <https://doi.org/10.1016/j.buildenv.2020.106929>.
- [253] Chinazzo G, Wienold J, Andersen M. Daylight affects human thermal perception. *Sci Rep* 2019;9:1–15. <https://doi.org/10.1038/s41598-019-48963-y>.
- [254] Golasi I, Salata F, Vollaro E de L, Peña-García A. Influence of lighting colour temperature on indoor thermal perception: a strategy to save energy from the HVAC installations. *Energy Build* 2019;185:112–22. <https://doi.org/10.1016/j.enbuild.2018.12.026>.
- [255] Yang W, Moon HJ. Combined effects of acoustic, thermal, and illumination conditions on the comfort of discrete senses and overall indoor environment. *Build Environ* 2019;148:623–33. <https://doi.org/10.1016/j.buildenv.2018.11.040>.
- [256] Yang W, Moon HJ. Cross-modal effects of noise and thermal conditions on indoor environmental perception and speech recognition. *Appl Acoust* 2018;141:1–8. <https://doi.org/10.1016/j.apacoust.2018.06.019>.
- [257] Yang W, Kim M-J, Moon HJ. Effects of indoor temperature and background noise on floor impact noise perception. *Indoor Built Environ* 2019;28:454–69. <https://doi.org/10.1177/1420326X17753708>.
- [258] te Kulve M, Schlangen LJM, Schellen L, Frijns AJH, van Marken Lichtenbelt WD. The impact of morning light intensity and environmental temperature on body temperatures and alertness. *Physiol Behav* 2017;175:72–81. <https://doi.org/10.1016/j.physbeh.2017.03.043>.
- [259] te Kulve M, Schlangen L, van Marken Lichtenbelt W. Interactions between the perception of light and temperature. *Indoor Air* 2018;28:881–91. <https://doi.org/10.1111/ina.12500>.
- [260] Bjerre L, Larsen T, Sørensen AJ, Santurette S, Jeong C-H. On-site and laboratory evaluations of soundscape quality in recreational urban spaces. *Noise Health* 2017;19:183. [https://doi.org/10.4103/nah.NAH\\_109\\_16](https://doi.org/10.4103/nah.NAH_109_16).
- [261] Huebner GM, Shipworth DT, Gauthier S, Witzel C, Raynham P, Chan W. Saving energy with light? Experimental studies assessing the impact of colour temperature on thermal comfort. *Energy Res Soc Sci* 2016;15:45–57. <https://doi.org/10.1016/j.erss.2016.02.008>.
- [262] Hong JY, Jeon JY. Designing sound and visual components for enhancement of urban soundscapes. *J Acoust Soc Am* 2013;134:2026–36. <https://doi.org/10.1121/1.4817924>.
- [263] Pellerin N, Candas V. Combined effects of temperature and noise on human discomfort. *Physiol Behav* 2003;78:99–106. [https://doi.org/10.1016/S0031-9384\(02\)00956-3](https://doi.org/10.1016/S0031-9384(02)00956-3).
- [264] Greene TC, Bell PA. Additional considerations concerning the effects of warm and cool wall colours on energy conservation. *Ergonomics* 1980. <https://doi.org/10.1080/00140138008924804>.
- [265] Clausen G, Carrick L, Fanger PO, Kim SW, Poulsen T, Rindel JH. A comparative study of discomfort caused by indoor air pollution, thermal load and noise. *Indoor Air* 1993;3:255–62. <https://doi.org/10.1111/j.1600-0668.1993.00006.x>.
- [266] Fanger PO, Breum NO, Jerking E. Can colour and noise influence man's thermal comfort? *Ergonomics* 1977;20:11–8. <https://doi.org/10.1080/00140137708931596>.
- [267] Chinazzo G, Wienold J, Andersen M. Effect of indoor temperature and glazing with saturated color on visual perception of daylight. *LEUKOS - J Illum Eng Soc North Am* 2020. <https://doi.org/10.1080/15502724.2020.1726182>.
- [268] Chinazzo G, Wienold J, Andersen M. Influence of indoor temperature and daylight illuminance on visual perception. *Light Res Technol* 2020;52:350–70. <https://doi.org/10.1177/1477153519859609>.
- [269] Jing S, Li B, Tan M, Liu H. Impact of relative humidity on thermal comfort in a warm environment. *Indoor Built Environ* 2013;22:598–607. <https://doi.org/10.1177/1420326X12447614>.



- [270] Sunwoo Y, Chou C, Takeshita J, Murakami M, Tochihara Y. Physiological and subjective responses to low relative humidity. *J Physiol Anthropol* 2006;25:7–14. <https://doi.org/10.2114/jpa2.25.7>.
- [271] Schweiker M, Wagner A. The effect of occupancy on perceived control, neutral temperature, and behavioral patterns. *Energy Build* 2016;117:246–59. <https://doi.org/10.1016/j.enbuild.2015.10.051>.
- [272] Chen Y, Raphael B, Sekhar SC. Individual control of a personalized ventilation system integrated with an ambient mixing ventilation system. *HVAC R Res* 2012;18:1136–52. <https://doi.org/10.1080/10789669.2012.710059>.
- [273] Toftum J, Kolarik J, Belkowska D, Olesen BW. Influence on occupant responses of behavioral modification of clothing insulation in nonsteady thermal environments (RP-1269). *HVAC R Res* 2010;16:59–74. <https://doi.org/10.1080/10789669.2010.10390892>.
- [274] Choi Y, Kim M, Chun C. Measurement of occupants' stress based on electroencephalograms (EEG) in twelve combined environments. *Build Environ* 2015;88:65–72. <https://doi.org/10.1016/j.buildenv.2014.10.003>.
- [275] Kolarik J, Toftum J, Olesen BW, Shitzer A. Occupant responses and office work performance in environments with moderately drifting operative temperatures (RP-1269). *HVAC R Res* 2009;15:931–60. <https://doi.org/10.1080/10789669.2009.10390873>.
- [276] Almesri I, Awbi HB, Foda E, Sirén K. An air distribution index for assessing the thermal comfort and air quality in uniform and nonuniform thermal environments. *Indoor Built Environ* 2013;22:618–39. <https://doi.org/10.1177/1420326X12451186>.
- [277] Choi JH, Loftness V. Investigation of human body skin temperatures as a bio-signal to indicate overall thermal sensations. *Build Environ* 2012;58:258–69. <https://doi.org/10.1016/j.buildenv.2012.07.003>.
- [278] Hammoud M, Ghali K, Ghaddar N. The optimized operation of a solar hybrid desiccant/displacement ventilation combined with a personalized evaporative cooler. *Int J Green Energy* 2014;11:141–60. <https://doi.org/10.1080/15435075.2013.771360>.
- [279] Du C, Li B, Liu H, Ji Y, Yao R, Yu W. Quantification of personal thermal comfort with localized airflow system based on sensitivity analysis and classification tree model. *Energy Build* 2019;194:1–11. <https://doi.org/10.1016/j.enbuild.2019.04.010>.
- [280] Veselý M, Molenaar P, Vos M, Li R, Zeiler W. Personalized heating – comparison of heaters and control modes. *Build Environ* 2017;112:223–32. <https://doi.org/10.1016/j.buildenv.2016.11.036>.
- [281] Pasut W, Zhang H, Arens E, Zhai Y. Energy-efficient comfort with a heated/cooled chair: results from human subject tests. *Build Environ* 2015;84:10–21. <https://doi.org/10.1016/j.buildenv.2014.10.026>.
- [282] Watanabe S, Shimomura T, Miyazaki H. Thermal evaluation of a chair with fans as an individually controlled system. *Build Environ* 2009;44:1392–8. <https://doi.org/10.1016/j.buildenv.2008.05.016>.
- [283] Katić K, Li R, Verhaart J, Zeiler W. Neural network based predictive control of personalized heating systems. *Energy Build* 2018;174:199–213. <https://doi.org/10.1016/j.enbuild.2018.06.033>.
- [284] Kong M, Zhang J, Dang TQ, Hedge A, Teng T, Carter B, et al. Micro-environmental control for efficient local cooling: results from manikin and human participant tests. *Build Environ* 2019;160:106198. <https://doi.org/10.1016/j.buildenv.2019.106198>.
- [285] Chou C, Tochihara Y, Kim T. Physiological and subjective responses to cooling devices on firefighting protective clothing. *Eur J Appl Physiol* 2008;104:369–74. <https://doi.org/10.1007/s00421-007-0665-7>. Springer.
- [286] Song W, Wang F, Wei F. Hybrid cooling clothing to improve thermal comfort of office workers in a hot indoor environment. *Build Environ* 2016;100:92–101. <https://doi.org/10.1016/j.buildenv.2016.02.009>.
- [287] Boerstra A. Personal control in future thermal comfort standards. *Adapt To Chang New Think* 2010:9–11.
- [288] Ba M, Kang J. A laboratory study of the sound-odour interaction in urban environments. *Build Environ* 2019;147:314–26. <https://doi.org/10.1016/j.buildenv.2018.10.019>.
- [289] Zhang F, Haddad S, Nakisa B, Rastgoo MN, Candido C, Tjondronegoro D, et al. The effects of higher temperature setpoints during summer on office workers' cognitive load and thermal comfort. *Build Environ* 2017;123:176–88. <https://doi.org/10.1016/j.buildenv.2017.06.048>.
- [290] Choi JH, Yeom D. Investigation of the relationships between thermal sensations of local body areas and the whole body in an indoor built environment. *Energy Build* 2017;149:204–15. <https://doi.org/10.1016/j.enbuild.2017.05.062>.
- [291] Zhai Y, Zhang H, Zhang Y, Pasut W, Arens E, Meng Q. Comfort under personally controlled air movement in warm and humid environments. *Build Environ* 2013;65:109–17. <https://doi.org/10.1016/j.buildenv.2013.03.022>.
- [292] Li Y, Yuan Y, Li C, Han X, Zhang X. Human responses to high air temperature, relative humidity and carbon dioxide concentration in underground refuge chamber. *Build Environ* 2018;131:53–62. <https://doi.org/10.1016/j.buildenv.2017.12.038>.
- [293] Li R, Sekhar SC, Melikov AK. Thermal comfort and indoor air quality in rooms with integrated personalized ventilation and under-floor air distribution systems. *HVAC R Res* 2011;17:829–46. <https://doi.org/10.1080/10789669.2010.544834>.
- [294] Lan L, Lian Z, Pan L. The effects of air temperature on office workers' well-being, workload and productivity-evaluated with subjective ratings. *Appl Ergon* 2010;42:29–36. <https://doi.org/10.1016/j.apergo.2010.04.003>.
- [295] Melikov AK, Skwarczynski MA, Kaczmarczyk J, Zabecky J. Use of personalized ventilation for improving health, comfort, and performance at high room temperature and humidity. *Indoor Air* 2013;23:250–63. <https://doi.org/10.1111/ina.12012>.
- [296] Wu YC, Mahdavi A. Assessment of thermal comfort under transitional conditions. *Build Environ* 2014;76:30–6. <https://doi.org/10.1016/j.buildenv.2014.03.001>.
- [297] Zhang N, Cao B, Zhu Y. Effects of pre-sleep thermal environment on human thermal state and sleep quality. *Build Environ* 2019;148:600–8. <https://doi.org/10.1016/j.buildenv.2018.11.035>.
- [298] Cui W, Cao G, Park JH, Ouyang Q, Zhu Y. Influence of indoor air temperature on human thermal comfort, motivation and performance. *Build Environ* 2013;68:114–22. <https://doi.org/10.1016/j.buildenv.2013.06.012>.
- [299] Baniya RR, Tetri E, Virtanen J, Halonen L. The effect of correlated colour temperature of lighting on thermal sensation and thermal comfort in a simulated indoor workplace. *Indoor Built Environ* 2018;27:308–16. <https://doi.org/10.1177/1420326X16673214>.
- [300] Bolashikov Z, Melikov A, Spilak M. Experimental investigation on reduced exposure to pollutants indoors by applying wearable personalized ventilation. *HVAC R Res* 2013;19:385–99. <https://doi.org/10.1080/10789669.2013.784645>.
- [301] Pan Z, Kjaergaard SK, Mølhave L. A chamber-experiment investigation of the interaction between perceptions of noise and odor in humans. *Int Arch Occup Environ Health* 2003;76:598–604. <https://doi.org/10.1007/s00420-003-0464-3>.
- [302] Jung W, Jazizadeh F. Vision-based thermal comfort quantification for HVAC control. *Build Environ* 2018;142:513–23. <https://doi.org/10.1016/j.buildenv.2018.05.018>.
- [303] Sunwoo Y, Chou C, Takeshita J, Murakami M, Tochihara Y. Physiological and subjective responses to low relative humidity in young and elderly men. *J Physiol Anthropol* 2006;25:229–38. <https://doi.org/10.2114/jpa2.25.229>.
- [304] Bluyssen PM, van Zeist F, Kurvers S, Tenpierik M, Pont S, Wolters B, et al. The creation of SenseLab: a laboratory for testing and experiencing single and combinations of indoor environmental conditions. *Intell Build Int* 2018;10:5–18. <https://doi.org/10.1080/17508975.2017.1330187>.
- [305] Katić K, Li R, Zeiler W. Machine learning algorithms applied to a prediction of personal overall thermal comfort using skin temperatures and occupants' heating behavior. *Appl Ergon* 2020;85:103078. <https://doi.org/10.1016/j.apergo.2020.103078>.
- [306] Amai H, Tanabe S, Ichi, Akimoto T, Genma T. Thermal sensation and comfort with different task conditioning systems. *Build Environ* 2007;42:3955–64. <https://doi.org/10.1016/j.buildenv.2006.07.043>.
- [307] Grivel F, Candas V. Ambient temperatures preferred by young European males and females at rest. *Ergonomics* 1991;34:365–78. <https://doi.org/10.1080/00140139108967320>.
- [308] Xia YZ, Niu JL, Zhao RY, Burnett J. Effects of turbulent air on human thermal sensations in a warm isothermal environment. *Indoor Air* 2000;10:289–96. <https://doi.org/10.1034/j.1600-0668.2000.010004289.x>.
- [309] Havenith G, Griggs K, Qiu Y, Dorman L, Kulasekaran V, Hodder S. Higher comfort temperature preferences for anthropometrically matched Chinese and Japanese versus white-western-middle-European individuals using a personal comfort/cooling system. *Build Environ* 2020;183:107162. <https://doi.org/10.1016/j.buildenv.2020.107162>.
- [310] Newsham G, Mancini S, Veitch J, Marchand R, Lei W, Charles K, et al. Control strategies for lighting and ventilation in offices: effects on energy and occupants. *Intell Build Int* 2009;1:101–21. <https://doi.org/10.3763/inbi.2009.0004>.
- [311] Bluyssen PM, Kim DH, Eijkelenboom A, Ortiz-Sanchez M. Workshop with 335 primary school children in The Netherlands: what is needed to improve the IEQ in their classrooms? *Build Environ* 2020;168:106486. <https://doi.org/10.1016/j.buildenv.2019.106486>. Elsevier Ltd.
- [312] Liu S, Schiavon S, Kabanshi A, Nazaroff WW. Predicted percentage dissatisfied with ankle draft. *Indoor Air* 2017;27:852–62. <https://doi.org/10.1111/ina.12364>.
- [313] Jowkar M, Rijal HB, Brusey J, Montazami A, Carlucci S, Lansdown TC. Comfort temperature and preferred adaptive behaviour in various classroom types in the UK higher learning environments. *Energy Build* 2020;211. <https://doi.org/10.1016/j.enbuild.2020.109814>.
- [314] Yang Y, Li B, Liu H, Tan M, Yao R. A study of adaptive thermal comfort in a well-controlled climate chamber. *Appl Therm Eng* 2015;76:283–91. <https://doi.org/10.1016/j.applthermaleng.2014.11.004>.
- [315] O'Brien W, Wagner A, Schweiker M, Mahdavi A, Day J, Kjaergaard MB, et al. Introducing IEA EBC annex 79: key challenges and opportunities in the field of occupant-centric building design and operation. *Build Environ* 2020;178. <https://doi.org/10.1016/j.buildenv.2020.106738>.
- [316] Kim J, Schiavon S, Brager G. Personal comfort models – a new paradigm in thermal comfort for occupant-centric environmental control. *Build Environ* 2018;132:114–24. <https://doi.org/10.1016/j.buildenv.2018.01.023>.
- [317] de Gracia A, Navarro L, Coma J, Serrano S, Romani J, Pérez G, et al. Experimental set-up for testing active and passive systems for energy savings in buildings – lessons learnt. *Renew Sustain Energy Rev* 2018;82:1014–26. <https://doi.org/10.1016/j.rser.2017.09.109>.